



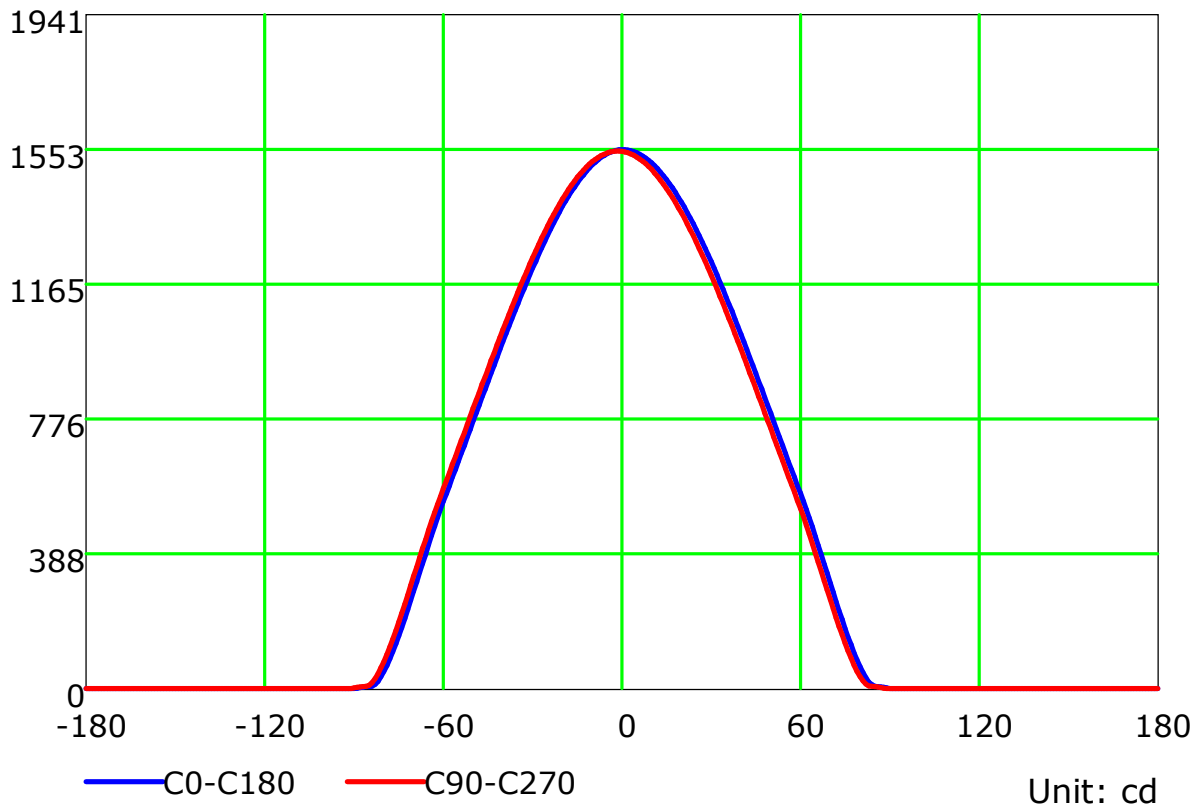


## Luminous Intensity Distribution Curve

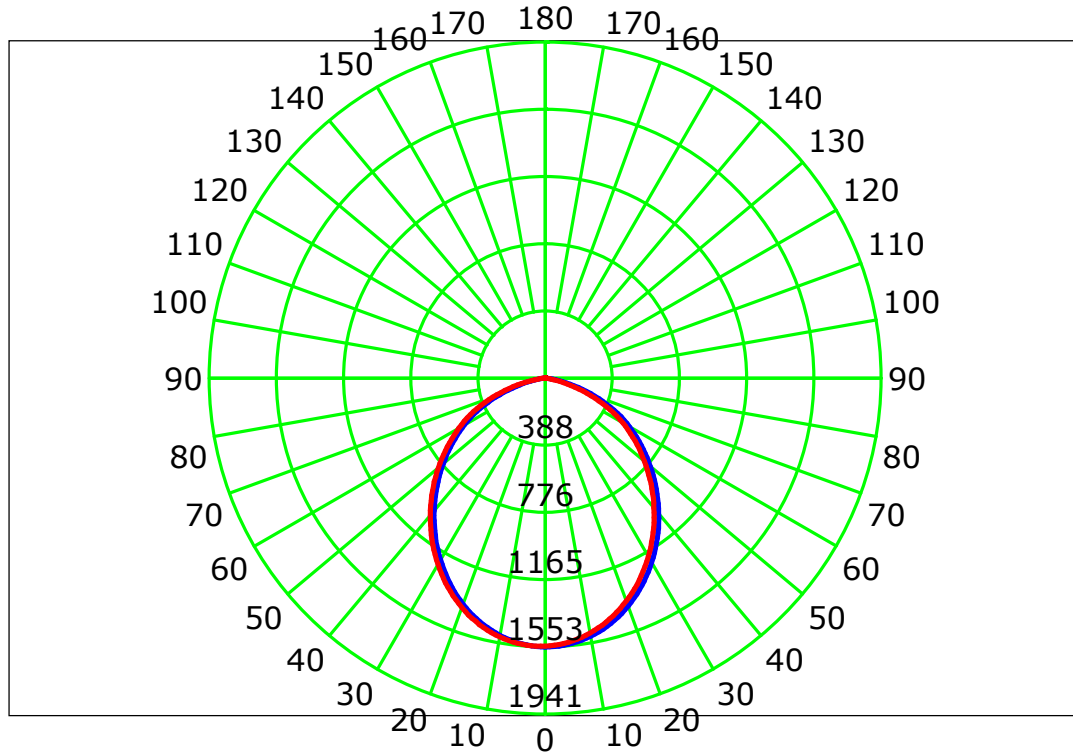

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-180.0:1.0  
Test Device: GPM-1600L  
Distance: 9.973 m [K=1.0000]  
Humidity:  
Inspector:


## Luminous Intensity Distribution Curve(cd/klm)

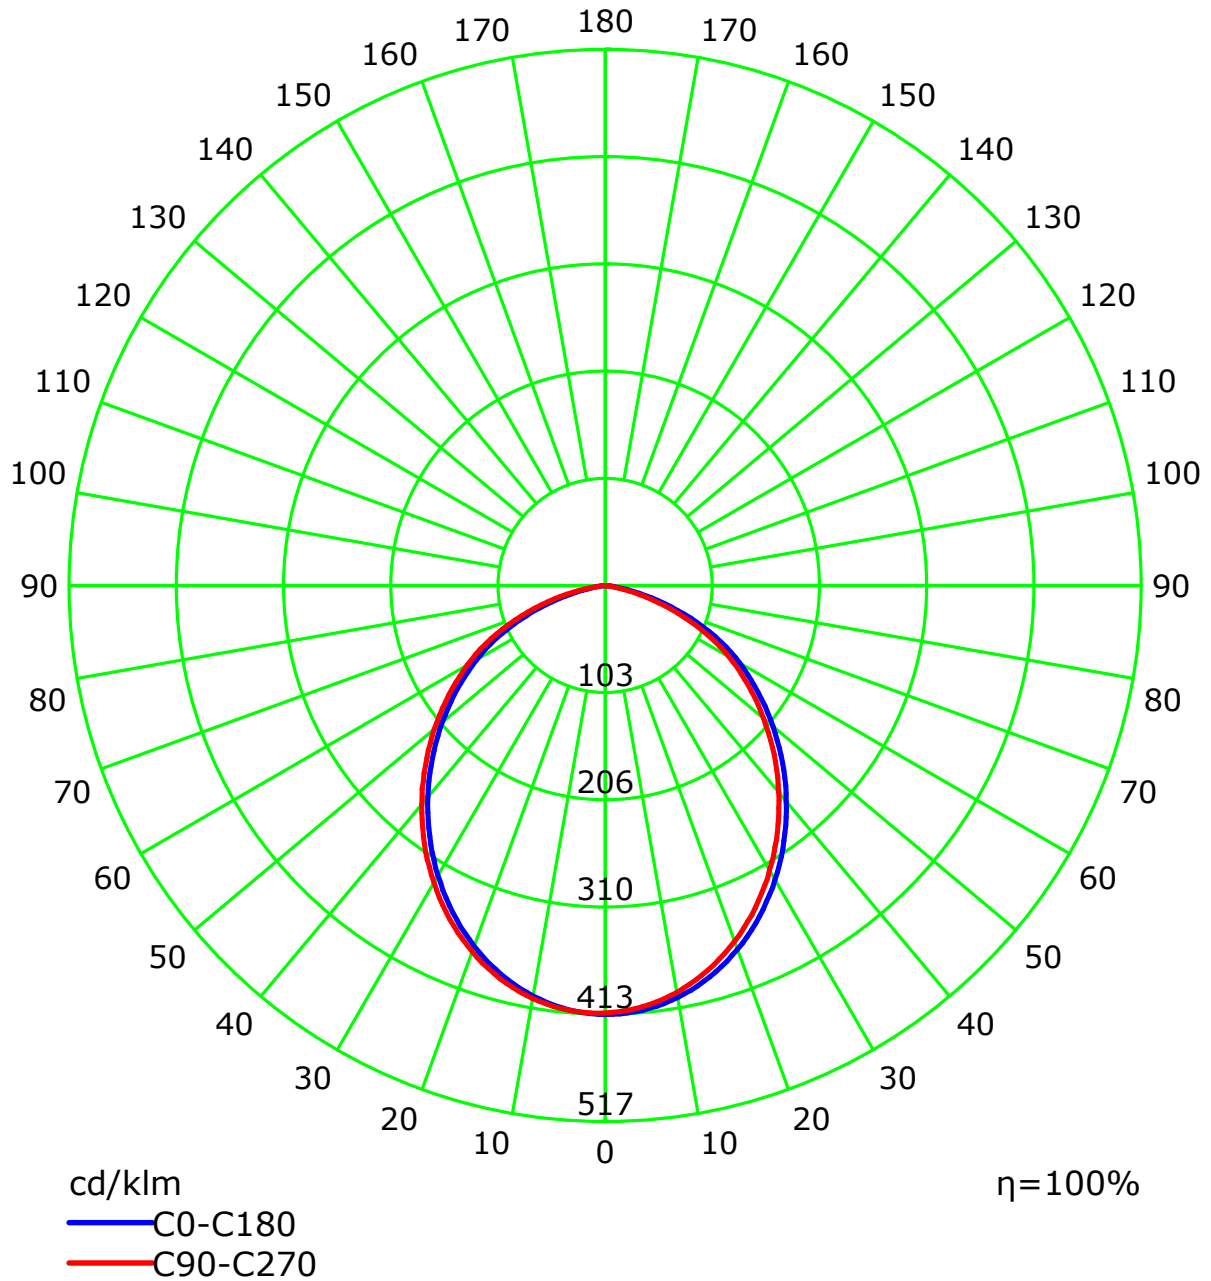

### Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.19	1.19	1.19	1.19	1.16	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1	1.10	1.06	1.02	0.98	1.07	1.03	1.00	0.97	0.99	0.96	0.94	0.95	0.93	0.91	0.92	0.90	0.88	0.86
2	1.00	0.93	0.86	0.81	0.98	0.91	0.85	0.80	0.87	0.83	0.78	0.84	0.80	0.77	0.81	0.78	0.75	0.73
3	0.92	0.82	0.74	0.68	0.90	0.80	0.73	0.68	0.78	0.71	0.66	0.75	0.70	0.65	0.72	0.68	0.64	0.62
4	0.84	0.73	0.65	0.58	0.82	0.72	0.64	0.58	0.69	0.62	0.57	0.67	0.61	0.56	0.65	0.60	0.56	0.53
5	0.78	0.65	0.57	0.50	0.76	0.64	0.56	0.50	0.62	0.55	0.50	0.60	0.54	0.49	0.59	0.53	0.49	0.47
6	0.72	0.59	0.51	0.44	0.70	0.58	0.50	0.44	0.56	0.49	0.44	0.55	0.48	0.43	0.53	0.47	0.43	0.41
7	0.67	0.54	0.45	0.39	0.65	0.53	0.45	0.39	0.51	0.44	0.39	0.50	0.43	0.39	0.49	0.43	0.38	0.36
8	0.62	0.49	0.41	0.35	0.61	0.48	0.41	0.35	0.47	0.40	0.35	0.46	0.39	0.35	0.45	0.39	0.34	0.33
9	0.58	0.45	0.37	0.32	0.57	0.45	0.37	0.32	0.44	0.36	0.32	0.42	0.36	0.31	0.41	0.36	0.31	0.29
10	0.55	0.42	0.34	0.29	0.53	0.41	0.34	0.29	0.40	0.33	0.29	0.39	0.33	0.29	0.39	0.33	0.28	0.27


Spacing Criteria (0-180): 1.18  
 Spacing Criteria (90-270): 1.18  
 Spacing Criteria (Diagonal): 1.29

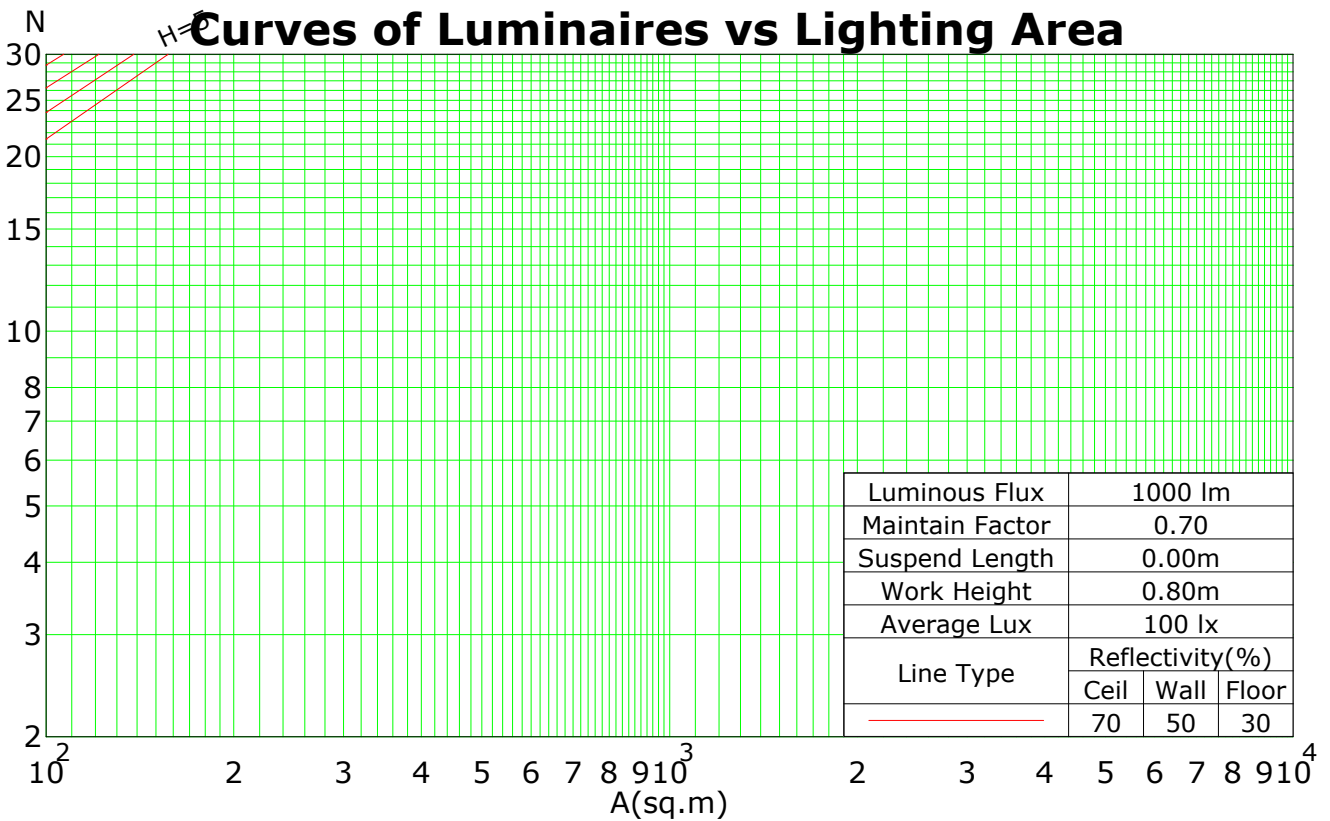

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:

## IsoLux Plot

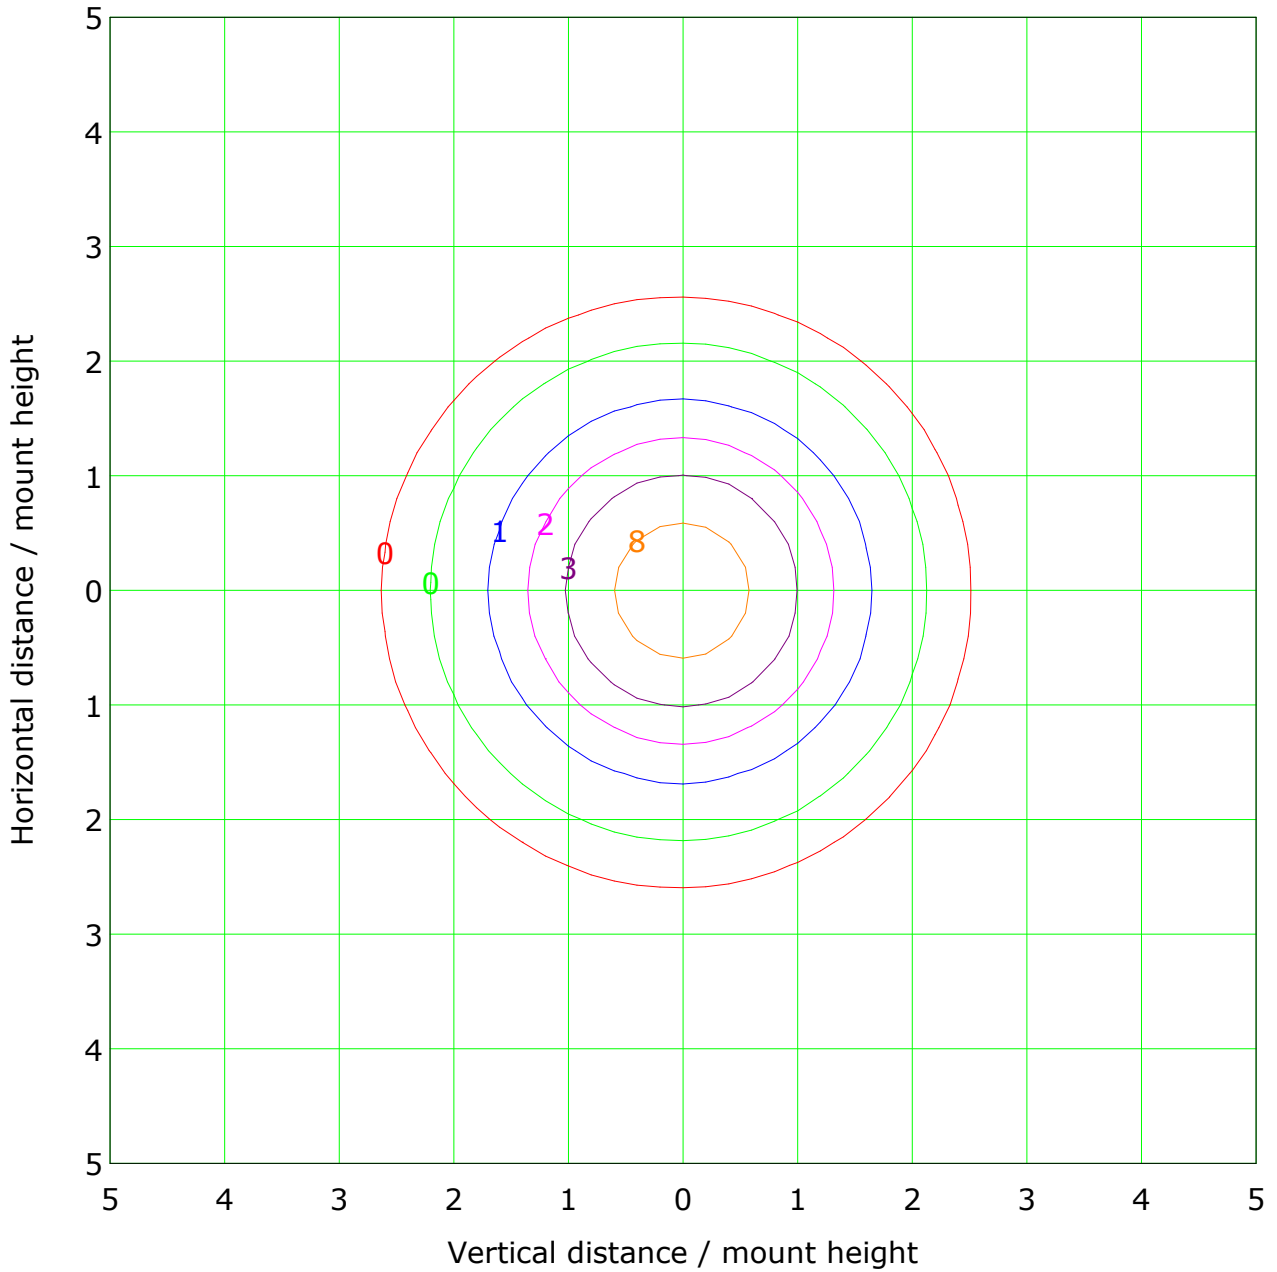

Mounting Height: 10.0m    Max Lux(100%): 15.5 lx	
— ( 1%): 0.2 lx	— ( 2%): 0.3 lx
— ( 5%): 0.8 lx	— ( 10%): 1.6 lx
— ( 20%): 3.1 lx	— ( 50%): 7.8 lx
— (100%): 15.5 lx	



C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:

## Lum Limit Curve

Dazzle	Quality	Illuminance (lx)									
		2000	1000	500	<=300						
1.15	A										
1.50	B										
1.85	C										
2.20	D										
2.55	E										

a b c d e f g h

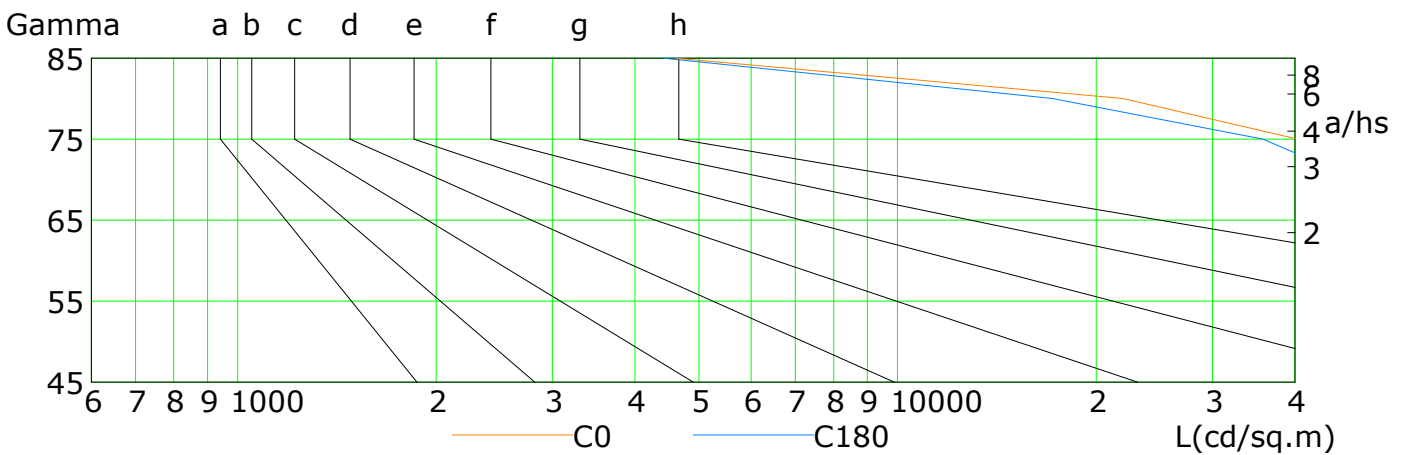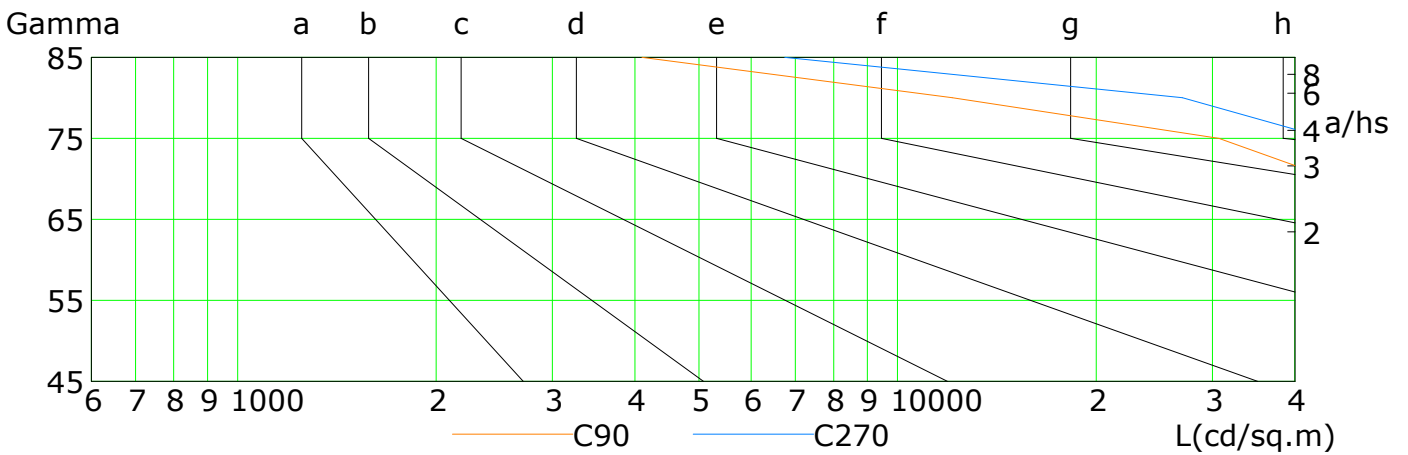


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	77854	74811	71554	68151	62880	53867	40521	21939	4600
C90	74148	70701	66999	62893	56042	45492	30679	12094	4099
C180	75861	72730	69233	65467	59556	49809	35782	17162	4412
C270	78906	76164	73092	69887	65519	57343	44959	27017	6747


C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-180.0:1.0  
Test Device: GPM-1600L  
Distance: 9.973 m [K=1.0000]  
Humidity:  
Inspector:

## Illuminance at a Distance

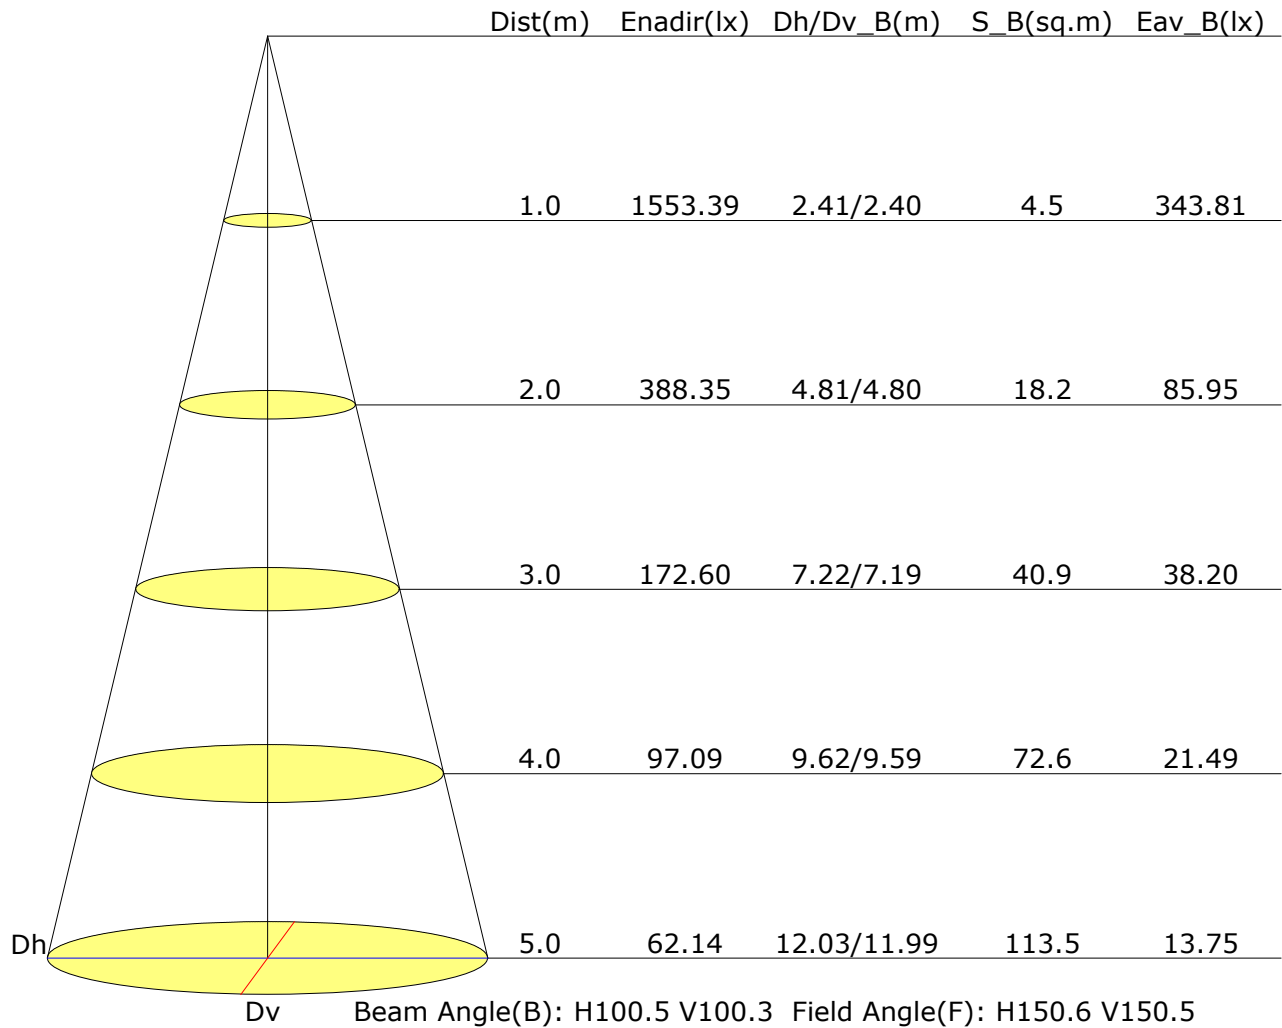

## Vertical IsoLux Plot

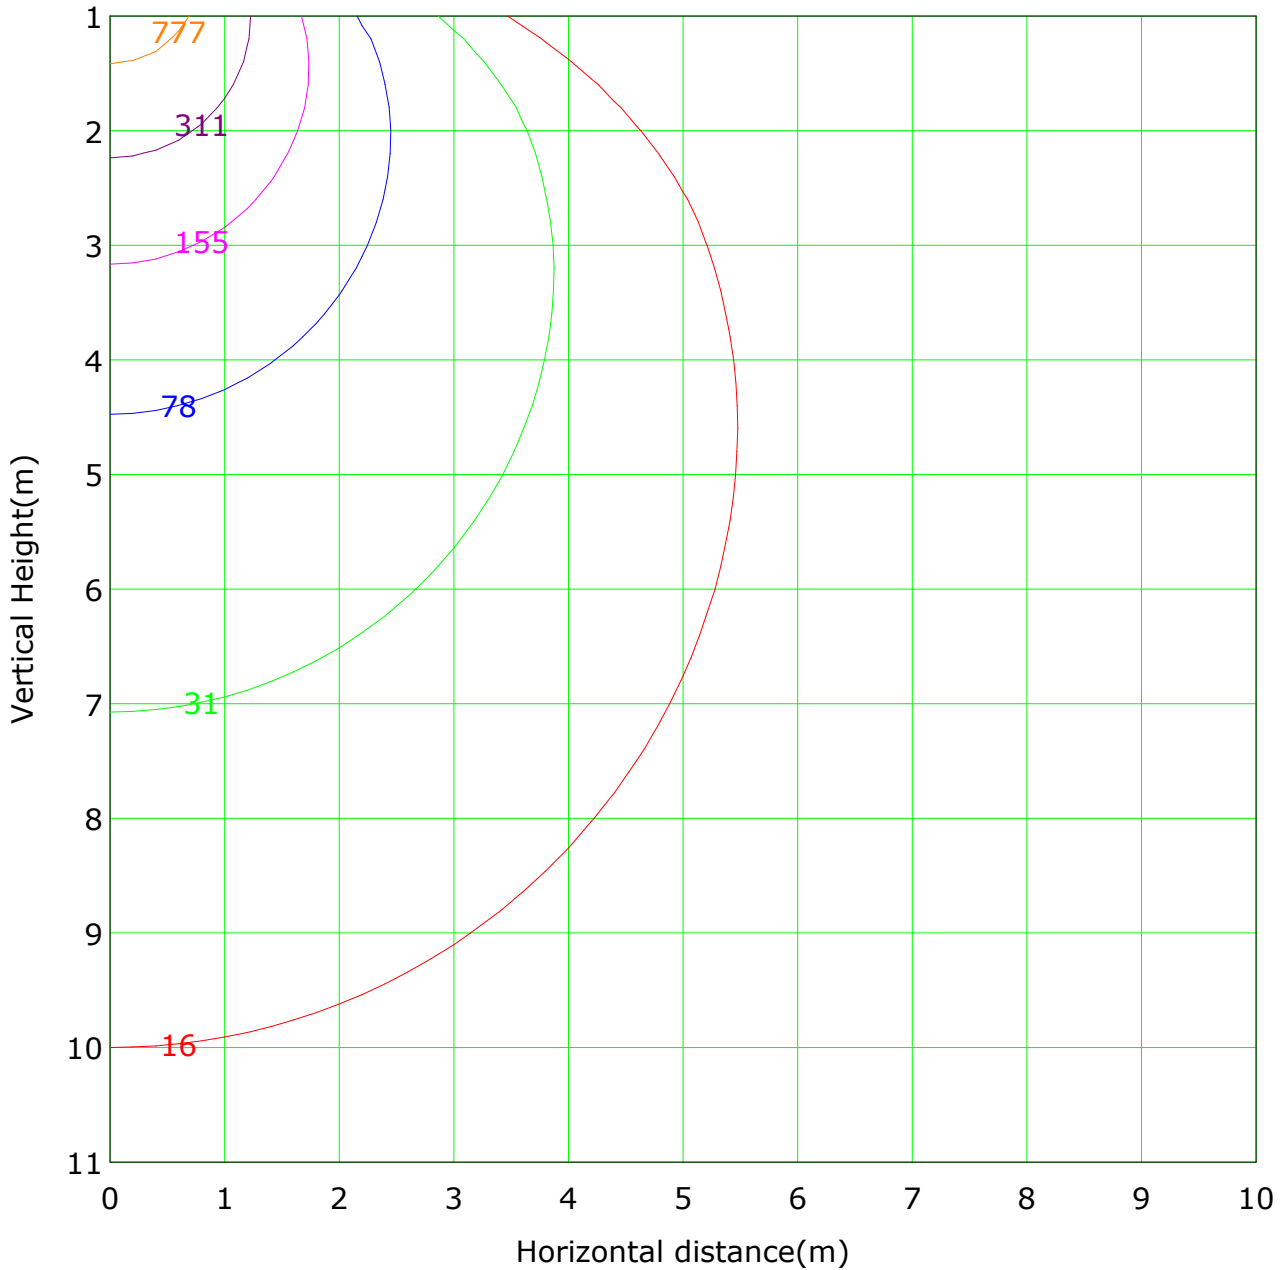

Lowest(m): 1.0m    Highest(m): 11.0m    Max Lux: 1553.4 lx

— ( 1%): 15.5 lx	— ( 2%): 31.1 lx
— ( 5%): 77.7 lx	— ( 10%): 155.3 lx
— ( 20%): 310.7 lx	— ( 50%): 776.7 lx
— (100%):1553.4 lx	




**Area Flux Table**

Unit: lm

		Vertical plane																		90 Flux(T) Flux(E)	3687
		-90	-80	-70	-60	-50	-40	-30	-20	-10	0	10	20	30	40	50	60	70	80		
Horizontal plane	Flux(E)	0.0	0.0	0.0	0.1	0.2	0.3	0.4	0.6	0.6	0.7	0.6	0.4	0.3	0.3	0.2	0.1	0.1	0.0	0.0	0.0
	Flux(T)	0.4	10.9	48.9	111.2	188.9	274.0	355.1	441.9	545.5	645.5	742.1	835.9	922.9	1019.4	1115.7	1212.5	1309.0	1405.5	1502.0	1598.5
	Flux(E)	5.4	44.5	107.0	184.9	270.1	351.3	441.5	545.1	651.1	758.8	868.1	978.1	1088.7	1200.0	1312.0	1424.5	1537.5	1651.0	1765.0	1879.5
	Flux(T)	10.9	48.9	111.2	188.9	274.0	355.1	441.9	545.5	645.5	742.1	835.9	922.9	1019.4	1115.7	1212.5	1309.0	1405.5	1502.0	1598.5	1695.0
	Flux(E)	5.4	44.5	107.0	184.9	270.1	351.3	441.5	545.1	651.1	758.8	868.1	978.1	1088.7	1200.0	1312.0	1424.5	1537.5	1651.0	1765.0	1879.5
	Flux(T)	10.9	48.9	111.2	188.9	274.0	355.1	441.9	545.5	645.5	742.1	835.9	922.9	1019.4	1115.7	1212.5	1309.0	1405.5	1502.0	1598.5	1695.0
	Flux(E)	5.4	44.5	107.0	184.9	270.1	351.3	441.5	545.1	651.1	758.8	868.1	978.1	1088.7	1200.0	1312.0	1424.5	1537.5	1651.0	1765.0	1879.5
	Flux(T)	10.9	48.9	111.2	188.9	274.0	355.1	441.9	545.5	645.5	742.1	835.9	922.9	1019.4	1115.7	1212.5	1309.0	1405.5	1502.0	1598.5	1695.0
	Flux(E)	5.4	44.5	107.0	184.9	270.1	351.3	441.5	545.1	651.1	758.8	868.1	978.1	1088.7	1200.0	1312.0	1424.5	1537.5	1651.0	1765.0	1879.5
	Flux(T)	10.9	48.9	111.2	188.9	274.0	355.1	441.9	545.5	645.5	742.1	835.9	922.9	1019.4	1115.7	1212.5	1309.0	1405.5	1502.0	1598.5	1695.0


## The Average Illuminance Effective Figure

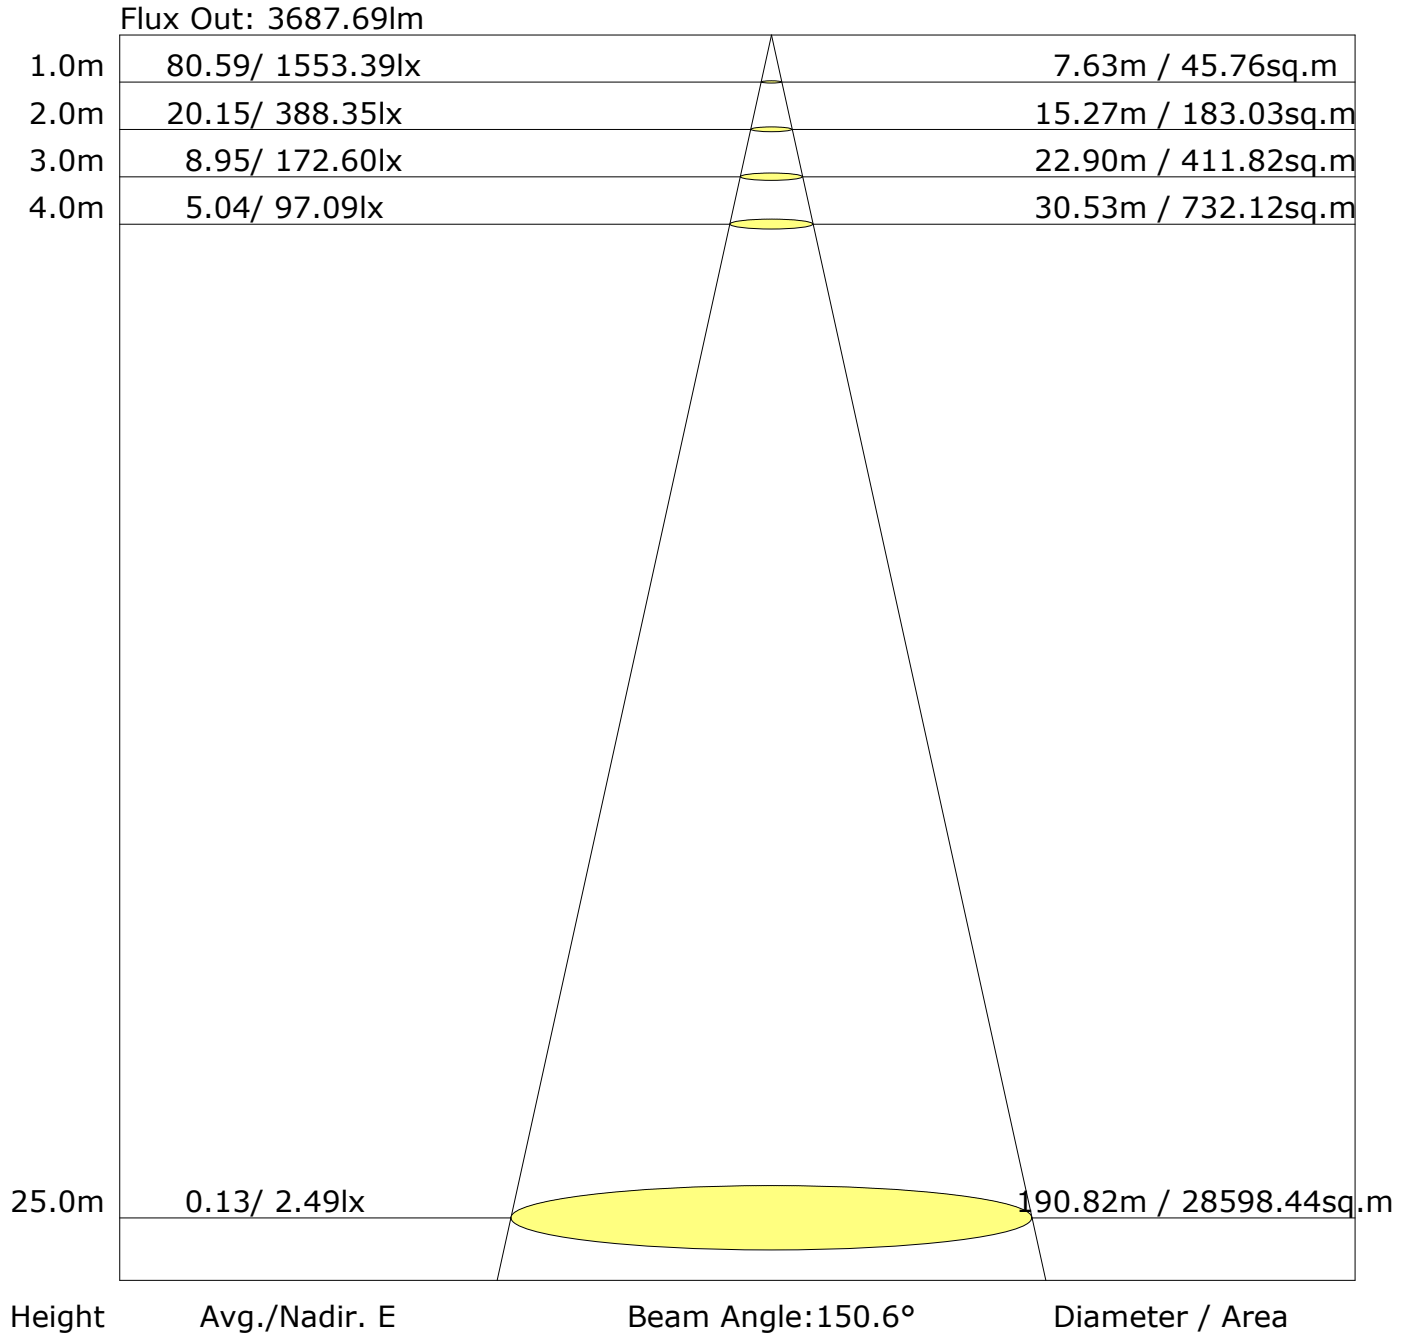

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-180.0:1.0  
Test Device: GPM-1600L  
Distance: 9.973 m [K=1.0000]  
Humidity:  
Inspector:

**FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM**

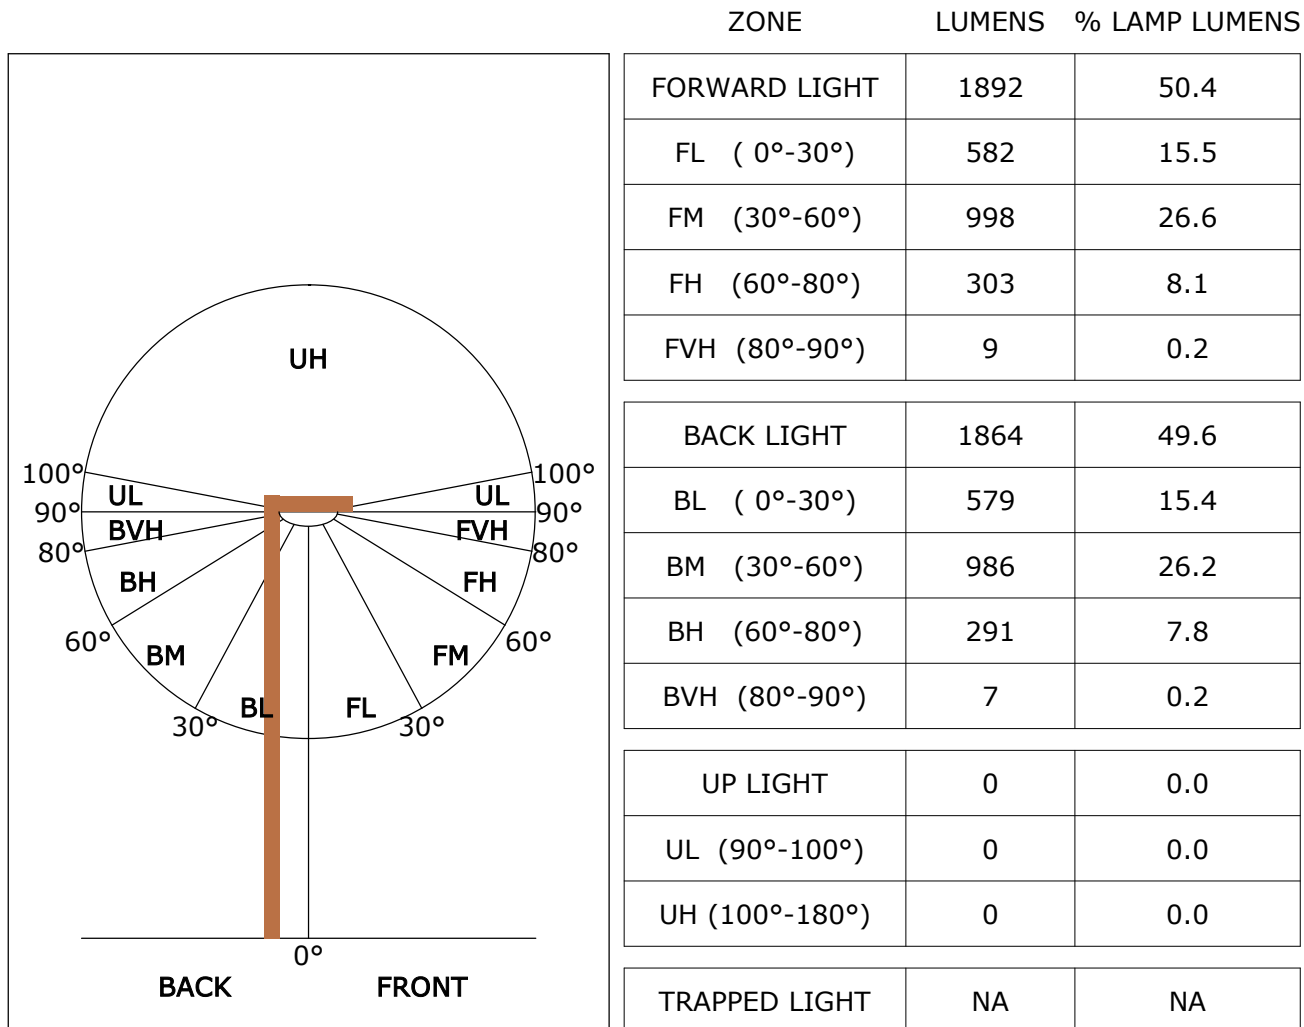

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U1 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U1 G0

C Plane (°):0.0-360.0: 90.0  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-180.0:1.0  
Test Device: GPM-1600L  
Distance: 9.973 m [K=1.0000]  
Humidity:  
Inspector:

## Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.60	0.70	0.78	0.83	0.90	0.95	0.98	1.02	1.05	
	0.30		0.53	0.63	0.71	0.76	0.84	0.90	0.94	0.99	1.02	
	0.20		0.47	0.58	0.66	0.71	0.80	0.86	0.90	0.95	0.99	
0.50	0.50	0.20	0.58	0.68	0.75	0.80	0.87	0.91	0.94	0.98	1.01	
	0.30		0.52	0.62	0.69	0.75	0.82	0.87	0.91	0.95	0.98	
	0.20		0.47	0.57	0.65	0.70	0.78	0.84	0.87	0.93	0.96	
0.30	0.50	0.20	0.57	0.67	0.73	0.78	0.84	0.88	0.91	0.95	0.97	
	0.30		0.51	0.61	0.68	0.73	0.80	0.85	0.88	0.92	0.95	
	0.20		0.47	0.57	0.64	0.69	0.77	0.82	0.85	0.90	0.93	
0.00	0.00	0.00	0.44	0.54	0.61	0.66	0.73	0.78	0.81	0.86	0.88	
<p>Rating:32W Photometrically tested without ceiling board.                      Multiply UF values by service correction factors                      Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.95	0.77	0.65	0.56	0.44	0.36	0.31	0.24	0.19	
	0.30		0.79	0.66	0.57	0.50	0.40	0.33	0.29	0.22	0.18	
	0.20		0.68	0.58	0.50	0.45	0.37	0.31	0.27	0.21	0.17	
0.50	0.50	0.20	0.91	0.74	0.62	0.54	0.42	0.38	0.29	0.22	0.18	
	0.30		0.77	0.64	0.55	0.48	0.39	0.32	0.28	0.21	0.17	
	0.20		0.67	0.57	0.49	0.44	0.36	0.30	0.26	0.20	0.17	
0.30	0.50	0.20	0.89	0.71	0.60	0.52	0.40	0.33	0.28	0.21	0.17	
	0.30		0.76	0.63	0.54	0.47	0.37	0.31	0.26	0.20	0.17	
	0.20		0.66	0.56	0.48	0.43	0.35	0.29	0.25	0.19	0.16	
0.00	0.00	0.00	0.56	0.46	0.39	0.34	0.27	0.22	0.19	0.14	0.12	
<p>Rating:32W Photometrically tested without ceiling board.                      Multiply UF values by service correction factors                      Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>												

## Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.21	0.22
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19
	0.20		0.05	0.06	0.08	0.09	0.11	0.13	0.14	0.16	0.17
0.50	0.50	0.20	0.15	0.16	0.17	0.18	0.19	0.19	0.20	0.20	0.21
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19
	0.20		0.05	0.06	0.08	0.09	0.11	0.13	0.14	0.16	0.17
0.30	0.50	0.20	0.15	0.16	0.17	0.17	0.18	0.19	0.19	0.19	0.20
	0.30		0.09	0.11	0.12	0.13	0.14	0.15	0.16	0.17	0.18
	0.20		0.05	0.06	0.08	0.09	0.11	0.12	0.14	0.15	0.16
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA
<p>Rating:32W Photometrically tested without ceiling board.                      Multiply UF values by service correction factors                      Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p>											

## Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	1553.4	1548.3	1553.4	1548.3	1553.4					
G1.0	1553.1	1546.6	1552.7	1549.1	1553.1					
G2.0	1552.3	1544.4	1551.3	1549.1	1552.3					
G3.0	1550.3	1540.9	1548.7	1548.2	1550.3					
G4.0	1547.7	1536.8	1545.7	1546.4	1547.7					
G5.0	1544.2	1532.1	1541.9	1544.0	1544.2					
G6.0	1539.6	1526.2	1536.7	1540.3	1539.6					
G7.0	1534.9	1520.0	1531.3	1536.3	1534.9					
G8.0	1529.1	1512.9	1524.5	1531.1	1529.1					
G9.0	1522.1	1504.6	1517.3	1525.2	1522.1					
G10.0	1515.2	1496.3	1509.8	1519.0	1515.2					
G11.0	1506.6	1486.0	1500.4	1511.4	1506.6					
G12.0	1498.1	1476.2	1491.3	1503.1	1498.1					
G13.0	1488.4	1465.7	1480.2	1493.7	1488.4					
G14.0	1477.7	1453.7	1469.8	1484.0	1477.7					
G15.0	1467.3	1441.6	1458.3	1474.2	1467.3					
G16.0	1455.6	1429.3	1445.4	1462.1	1455.6					
G17.0	1442.7	1415.3	1433.0	1450.8	1442.7					
G18.0	1430.4	1401.2	1419.6	1438.9	1430.4					
G19.0	1415.5	1385.9	1404.9	1424.7	1415.5					
G20.0	1401.8	1371.3	1390.3	1411.2	1401.8					
G21.0	1387.7	1356.2	1374.3	1396.2	1387.7					
G22.0	1371.6	1339.2	1358.5	1381.3	1371.6					
G23.0	1356.3	1322.3	1342.7	1366.5	1356.3					
G24.0	1339.9	1305.8	1324.4	1349.8	1339.9					
G25.0	1322.2	1287.2	1307.7	1333.3	1322.2					
G26.0	1305.6	1268.9	1289.0	1316.3	1305.6					
G27.0	1286.2	1249.6	1269.9	1297.9	1286.2					
G28.0	1268.7	1231.5	1252.1	1280.1	1268.7					
G29.0	1250.7	1212.9	1231.4	1261.1	1250.7					
G30.0	1230.6	1191.3	1212.7	1242.1	1230.6					
G31.0	1211.2	1172.1	1192.9	1223.8	1211.2					
G32.0	1192.2	1152.7	1172.0	1202.6	1192.2					
G33.0	1171.1	1130.0	1151.6	1183.5	1171.1					
G34.0	1150.7	1110.1	1131.8	1163.4	1150.7					
G35.0	1128.9	1088.0	1108.8	1142.0	1128.9					
G36.0	1108.0	1066.7	1088.6	1121.3	1108.0					

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:

## Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	1087.9	1045.2	1065.4	1099.4	1087.9					
G38.0	1065.3	1022.2	1044.8	1078.3	1065.3					
G39.0	1043.6	1001.2	1023.0	1056.8	1043.6					
G40.0	1020.6	978.0	1000.0	1034.1	1020.6					
G41.0	999.6	955.7	977.9	1012.4	999.6					
G42.0	977.3	934.3	955.5	991.3	977.3					
G43.0	953.9	909.7	932.0	967.1	953.9					
G44.0	931.5	888.2	909.3	945.8	931.5					
G45.0	909.1	865.8	885.8	921.3	909.1					
G46.0	885.5	842.0	863.2	898.9	885.5					
G47.0	863.7	819.1	840.6	877.5	863.7					
G48.0	838.8	795.1	816.8	852.8	838.8					
G49.0	817.0	772.4	795.0	831.2	817.0					
G50.0	794.1	750.4	772.0	808.4	794.1					
G51.0	770.1	725.5	747.2	784.5	770.1					
G52.0	747.2	703.7	725.2	761.7	747.2					
G53.0	724.3	680.9	700.2	737.7	724.3					
G54.0	700.5	657.2	678.4	714.9	700.5					
G55.0	677.7	634.6	655.7	692.3	677.7					
G56.0	653.7	610.8	631.0	668.6	653.7					
G57.0	630.8	588.0	609.4	645.9	630.8					
G58.0	609.1	566.5	584.6	621.2	609.1					
G59.0	584.3	541.8	562.1	599.6	584.3					
G60.0	562.7	519.3	540.5	577.0	562.7					
G61.0	540.1	496.8	516.9	553.4	540.1					
G62.0	516.3	470.9	492.9	530.9	516.3					
G63.0	492.2	445.7	467.9	507.9	492.2					
G64.0	465.9	417.6	441.3	482.3	465.9					
G65.0	438.8	391.1	415.6	457.2	438.8					
G66.0	412.7	364.8	387.0	429.3	412.7					
G67.0	385.0	337.1	360.5	404.3	385.0					
G68.0	358.5	310.5	335.4	378.0	358.5					
G69.0	333.1	284.3	307.7	350.4	333.1					
G70.0	304.2	256.9	281.3	323.9	304.2					
G71.0	277.9	231.1	254.9	297.4	277.9					
G72.0	250.6	204.5	227.9	269.9	250.6					
G73.0	224.7	179.7	202.7	244.0	224.7					

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:



## Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G74.0	200.2	155.4	175.6	217.3	200.2					
G75.0	173.2	131.1	152.9	192.1	173.2					
G76.0	149.1	108.9	129.7	167.7	149.1					
G77.0	127.0	88.1	106.7	142.9	127.0					
G78.0	103.0	67.9	86.1	120.2	103.0					
G79.0	83.4	50.7	66.9	99.5	83.4					
G80.0	62.9	34.7	49.2	77.5	62.9					
G81.0	46.5	22.4	34.7	60.1	46.5					
G82.0	32.0	13.7	20.8	42.9	32.0					
G83.0	18.9	7.6	12.4	29.1	18.9					
G84.0	11.2	6.5	7.2	17.4	11.2					
G85.0	6.6	5.9	6.3	9.7	6.6					
G86.0	6.1	4.9	5.7	6.7	6.1					
G87.0	5.3	3.6	4.6	6.2	5.3					
G88.0	4.1	1.7	3.0	5.4	4.1					
G89.0	2.6	0.7	1.4	4.2	2.6					
G90.0	0.9	0.8	0.7	2.6	0.9					
G91.0	0.0	0.0	0.0	0.0	0.0					
G92.0	0.0	0.0	0.0	0.0	0.0					
G93.0	0.0	0.0	0.0	0.0	0.0					
G94.0	0.0	0.0	0.0	0.0	0.0					
G95.0	0.0	0.0	0.0	0.0	0.0					
G96.0	0.0	0.0	0.0	0.0	0.0					
G97.0	0.0	0.0	0.0	0.0	0.0					
G98.0	0.0	0.0	0.0	0.0	0.0					
G99.0	0.0	0.0	0.0	0.0	0.0					
G100.0	0.0	0.0	0.0	0.0	0.0					
G101.0	0.0	0.0	0.0	0.0	0.0					
G102.0	0.0	0.0	0.0	0.0	0.0					
G103.0	0.0	0.0	0.0	0.0	0.0					
G104.0	0.0	0.0	0.0	0.0	0.0					
G105.0	0.0	0.0	0.0	0.0	0.0					
G106.0	0.0	0.0	0.0	0.0	0.0					
G107.0	0.0	0.0	0.0	0.0	0.0					
G108.0	0.0	0.0	0.0	0.0	0.0					
G109.0	0.0	0.0	0.0	0.0	0.0					
G110.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:

## Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G111.0	0.0	0.0	0.0	0.0	0.0					
G112.0	0.0	0.0	0.0	0.0	0.0					
G113.0	0.0	0.0	0.0	0.0	0.0					
G114.0	0.0	0.0	0.0	0.0	0.0					
G115.0	0.0	0.0	0.0	0.0	0.0					
G116.0	0.0	0.0	0.0	0.0	0.0					
G117.0	0.0	0.0	0.0	0.0	0.0					
G118.0	0.0	0.0	0.0	0.0	0.0					
G119.0	0.0	0.0	0.0	0.0	0.0					
G120.0	0.0	0.0	0.0	0.0	0.0					
G121.0	0.0	0.0	0.0	0.0	0.0					
G122.0	0.0	0.0	0.0	0.0	0.0					
G123.0	0.0	0.0	0.0	0.0	0.0					
G124.0	0.0	0.0	0.0	0.0	0.0					
G125.0	0.0	0.0	0.0	0.0	0.0					
G126.0	0.0	0.0	0.0	0.0	0.0					
G127.0	0.0	0.0	0.0	0.0	0.0					
G128.0	0.0	0.0	0.0	0.0	0.0					
G129.0	0.0	0.0	0.0	0.0	0.0					
G130.0	0.0	0.0	0.0	0.0	0.0					
G131.0	0.0	0.0	0.0	0.0	0.0					
G132.0	0.0	0.0	0.0	0.0	0.0					
G133.0	0.0	0.0	0.0	0.0	0.0					
G134.0	0.0	0.0	0.0	0.0	0.0					
G135.0	0.0	0.0	0.0	0.0	0.0					
G136.0	0.0	0.0	0.0	0.0	0.0					
G137.0	0.0	0.0	0.0	0.0	0.0					
G138.0	0.0	0.0	0.0	0.0	0.0					
G139.0	0.0	0.0	0.0	0.0	0.0					
G140.0	0.0	0.0	0.0	0.0	0.0					
G141.0	0.0	0.0	0.0	0.0	0.0					
G142.0	0.0	0.0	0.0	0.0	0.0					
G143.0	0.0	0.0	0.0	0.0	0.0					
G144.0	0.0	0.0	0.0	0.0	0.0					
G145.0	0.0	0.0	0.0	0.0	0.0					
G146.0	0.0	0.0	0.0	0.0	0.0					
G147.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector:

## Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G148.0	0.0	0.0	0.0	0.0	0.0					
G149.0	0.0	0.0	0.0	0.0	0.0					
G150.0	0.0	0.0	0.0	0.0	0.0					
G151.0	0.0	0.0	0.0	0.0	0.0					
G152.0	0.0	0.0	0.0	0.0	0.0					
G153.0	0.0	0.0	0.0	0.0	0.0					
G154.0	0.0	0.0	0.0	0.0	0.0					
G155.0	0.0	0.0	0.0	0.0	0.0					
G156.0	0.0	0.0	0.0	0.0	0.0					
G157.0	0.0	0.0	0.0	0.0	0.0					
G158.0	0.0	0.0	0.0	0.0	0.0					
G159.0	0.0	0.0	0.0	0.0	0.0					
G160.0	0.0	0.0	0.0	0.0	0.0					
G161.0	0.0	0.0	0.0	0.0	0.0					
G162.0	0.0	0.0	0.0	0.0	0.0					
G163.0	0.0	0.0	0.0	0.0	0.0					
G164.0	0.0	0.0	0.0	0.0	0.0					
G165.0	0.0	0.0	0.0	0.0	0.0					
G166.0	0.0	0.0	0.0	0.0	0.0					
G167.0	0.0	0.0	0.0	0.0	0.0					
G168.0	0.0	0.0	0.0	0.0	0.0					
G169.0	0.0	0.0	0.0	0.0	0.0					
G170.0	0.0	0.0	0.0	0.0	0.0					
G171.0	0.0	0.0	0.0	0.0	0.0					
G172.0	0.0	0.0	0.0	0.0	0.0					
G173.0	0.0	0.0	0.0	0.0	0.0					
G174.0	0.0	0.0	0.0	0.0	0.0					
G175.0	0.0	0.0	0.0	0.0	0.0					
G176.0	0.0	0.0	0.0	0.0	0.0					
G177.0	0.0	0.0	0.0	0.0	0.0					
G178.0	0.0	0.0	0.0	0.0	0.0					
G179.0	0.0	0.0	0.0	0.0	0.0					
G180.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0  
 Test Lab:  
 Test Type: TYPE C  
 Temperature:  
 Operator:

Gamma Plane (°):0.0-180.0:1.0  
 Test Device: GPM-1600L  
 Distance: 9.973 m [K=1.0000]  
 Humidity:  
 Inspector: