

Report No.:

Test Time: 2022/1/3 16:00:32

LUMINAIRE PHOTOMETRIC TEST REPORT

Luminaire Property

Manufacturer: 0
 Luminaire Type: OJL205 GRIS
 Lamp Type:
 Luminous Width: 200 mm
 Luminous Length: 200 mm
 Luminous Height: 50 mm


Voltage(V): 109.70 V
 Current(A): 0.1110 A
 Power(W): 12.18 W
 Power Factor: 0.9920
 Lamp Luminous Flux: 1047.99

Photometric Results


CIE Class: Direct
 Luminaire Luminous Flux: 1047.987 lm
 Downward Ratio: 100.00%
 Luminaire Efficacy Rating(LER): 86.04 lm/W
 Beam Angle(50%) C0-180,C90-270: 35.2,34.7
 Field Angle(10%) C0-180,C90-270: 56.4,56.2
 S/MH C0-180,C90-270: 0.573,0.573

Max. Intensity: 2573.85 cd
 Max.Intensity Angle: C=225 Gamma=2
 Upward Ratio: 0.00%
 Efficacy: 100.00%
 Center Intensity: 2525.84 cd
 Effective Luminous Flux: 862.77 lm
 ERP(φ use)(120deg): 967.20 lm

Picture of Luminaire



Luminous Intensity Distribution Curve

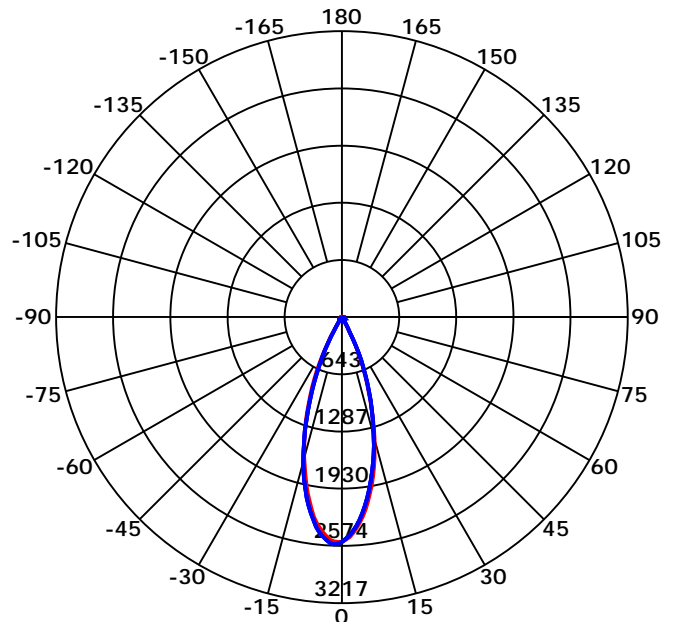

Beam Angle(50%) C0-180,C90-270: 35.2 deg,34.7 deg

C0-180 — C90-270 —



C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

Luminous Intensity Distribution Curve

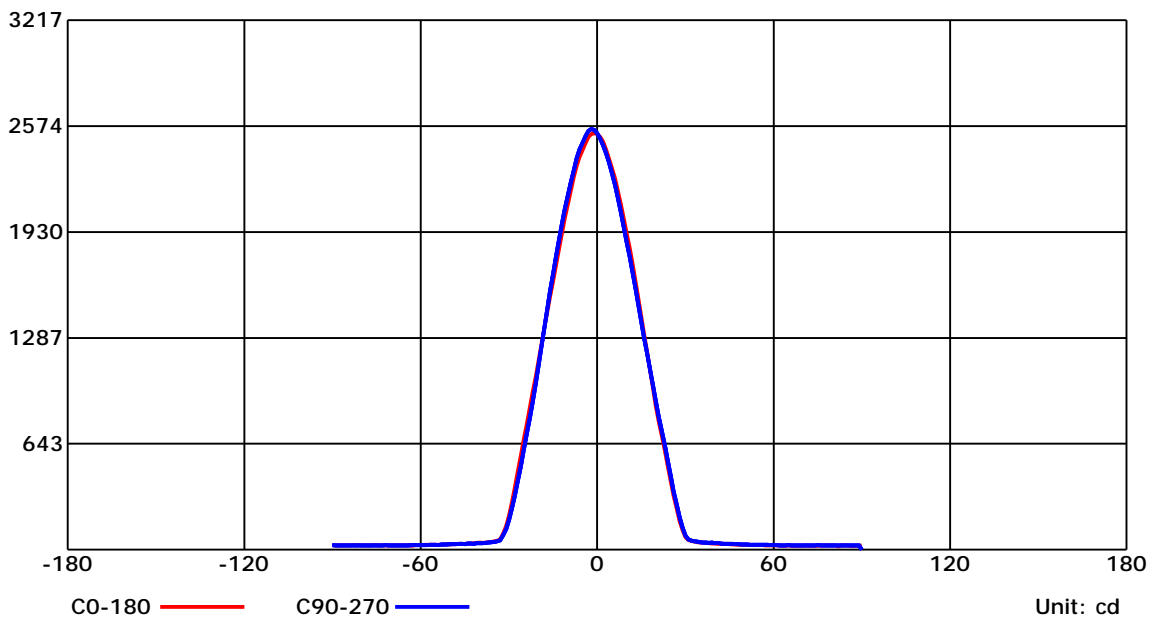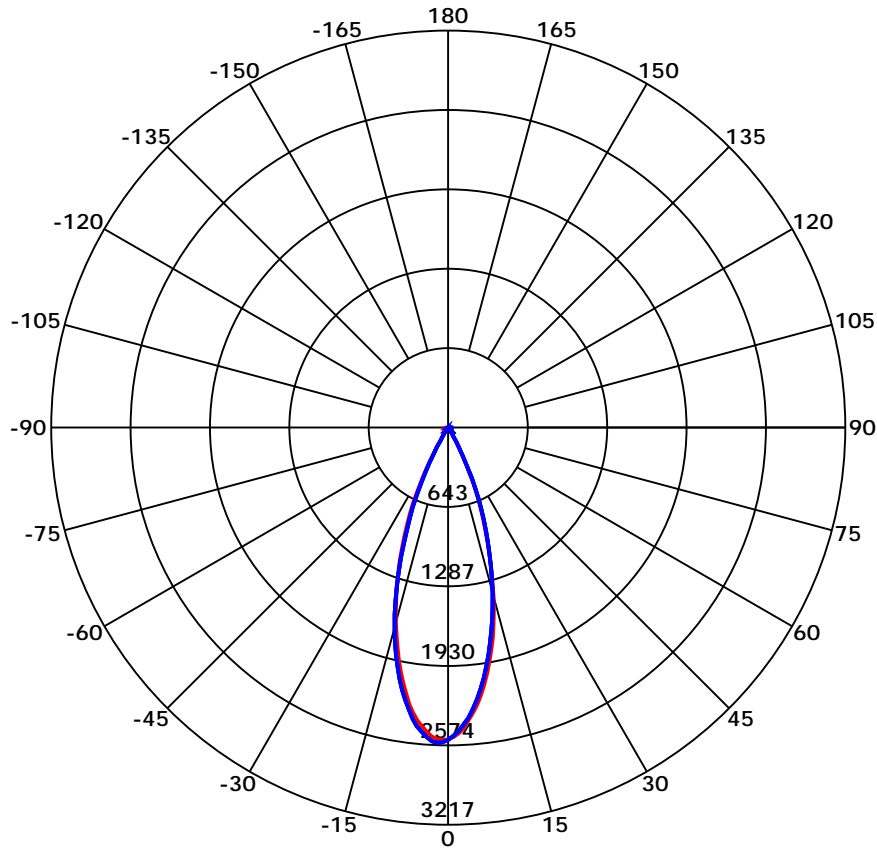


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

Luminous Intensity Distribution Curve

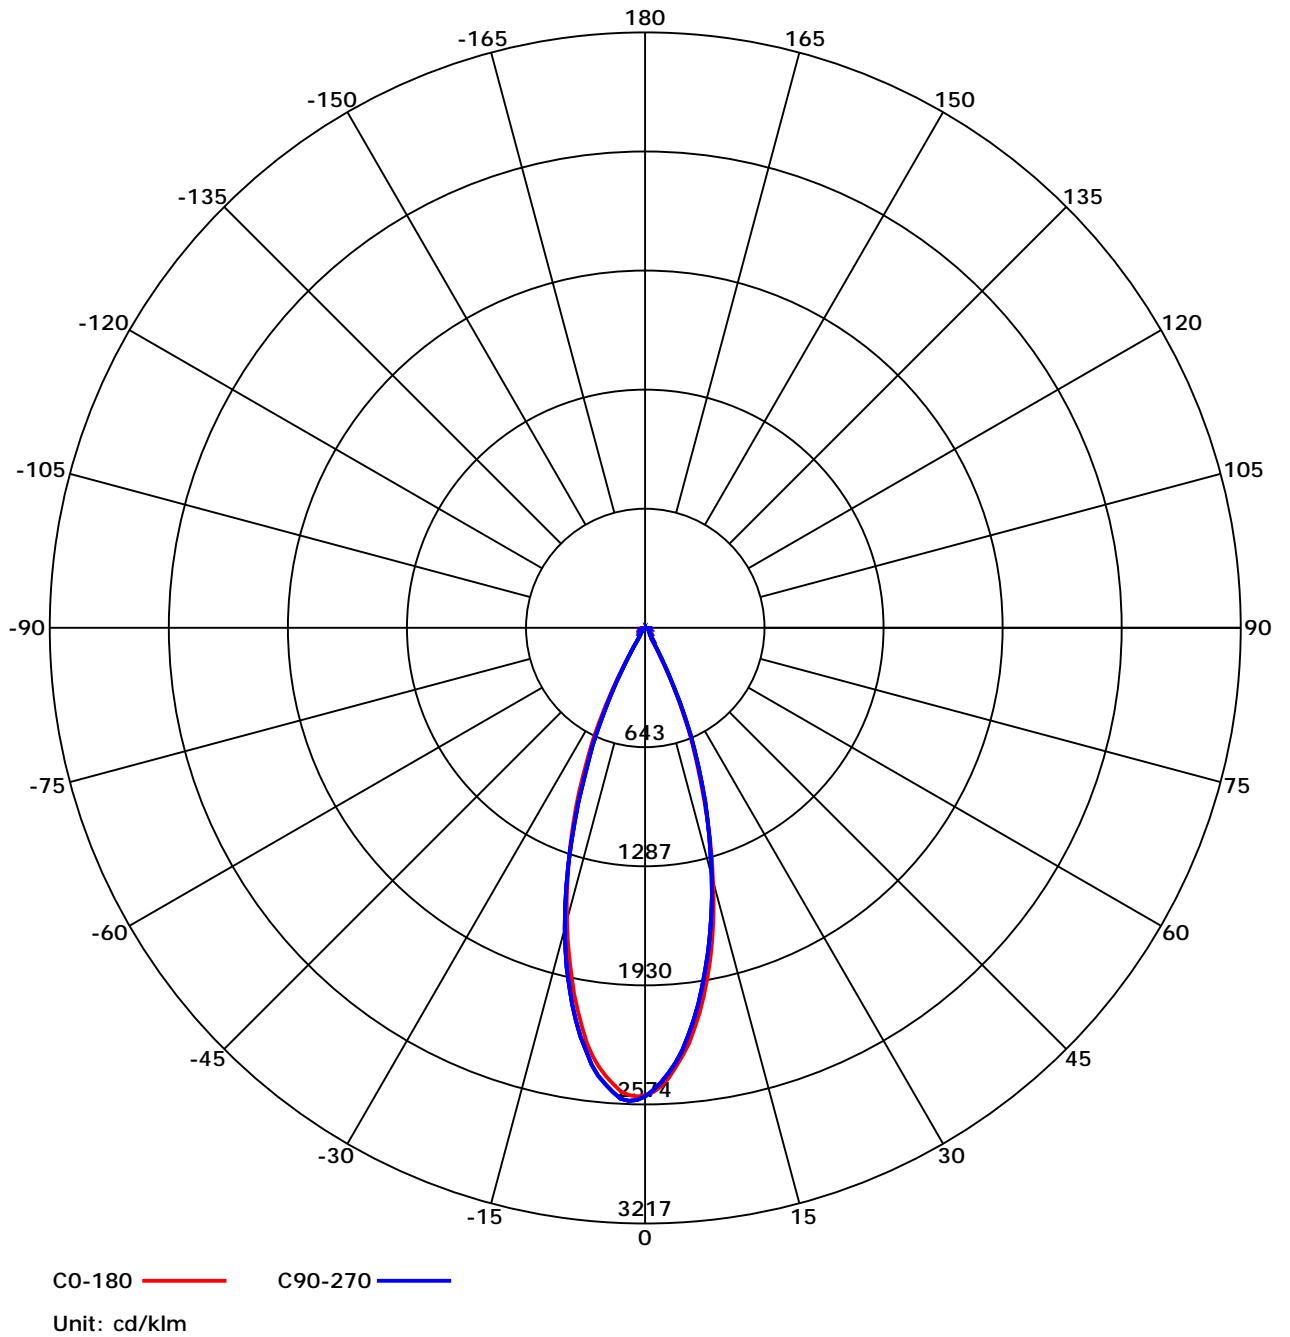

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:


Report No.:

Test Time: 2022/1/3 16:00:32

UTILIZATION FACTORS TABLE

RHOCC	80			70			50			30			10			0
RHOW	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	COEFFICIENTS OF UTILIZATION FOR RHOFC=20															
0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1	0.96	0.93	0.91	0.95	0.92	0.90	0.92	0.89	0.86	0.88	0.85	0.82	0.82	0.79	0.76	0.71
2	0.91	0.88	0.86	0.90	0.87	0.85	0.87	0.84	0.81	0.84	0.80	0.77	0.79	0.75	0.72	0.67
3	0.86	0.84	0.83	0.86	0.83	0.81	0.84	0.80	0.77	0.81	0.77	0.73	0.77	0.73	0.69	0.65
4	0.83	0.81	0.80	0.83	0.80	0.78	0.81	0.77	0.75	0.78	0.74	0.71	0.75	0.70	0.66	0.62
5	0.80	0.79	0.77	0.80	0.77	0.76	0.78	0.75	0.72	0.76	0.72	0.68	0.73	0.68	0.64	0.61
6	0.78	0.76	0.75	0.78	0.75	0.74	0.76	0.73	0.70	0.74	0.70	0.67	0.71	0.66	0.63	0.59
7	0.76	0.75	0.74	0.76	0.73	0.72	0.74	0.71	0.69	0.72	0.68	0.65	0.69	0.65	0.61	0.58
8	0.75	0.73	0.72	0.74	0.72	0.70	0.72	0.69	0.67	0.70	0.66	0.64	0.68	0.63	0.60	0.57
9	0.73	0.72	0.71	0.72	0.70	0.69	0.71	0.68	0.66	0.69	0.65	0.62	0.67	0.62	0.59	0.56
10	0.72	0.70	0.69	0.71	0.69	0.68	0.69	0.66	0.65	0.67	0.64	0.61	0.65	0.61	0.58	0.55

LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

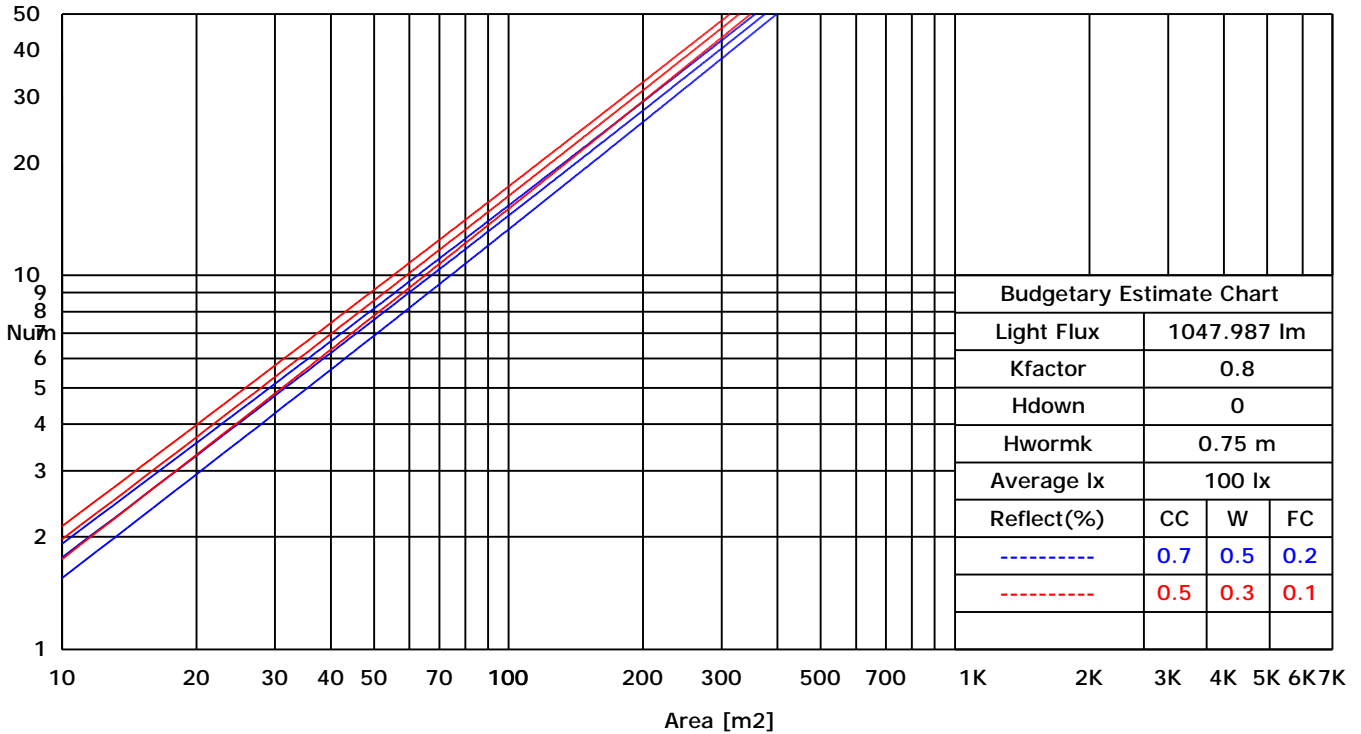


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

ISOCANDELA DIAGRAM (RECTANGULAR)

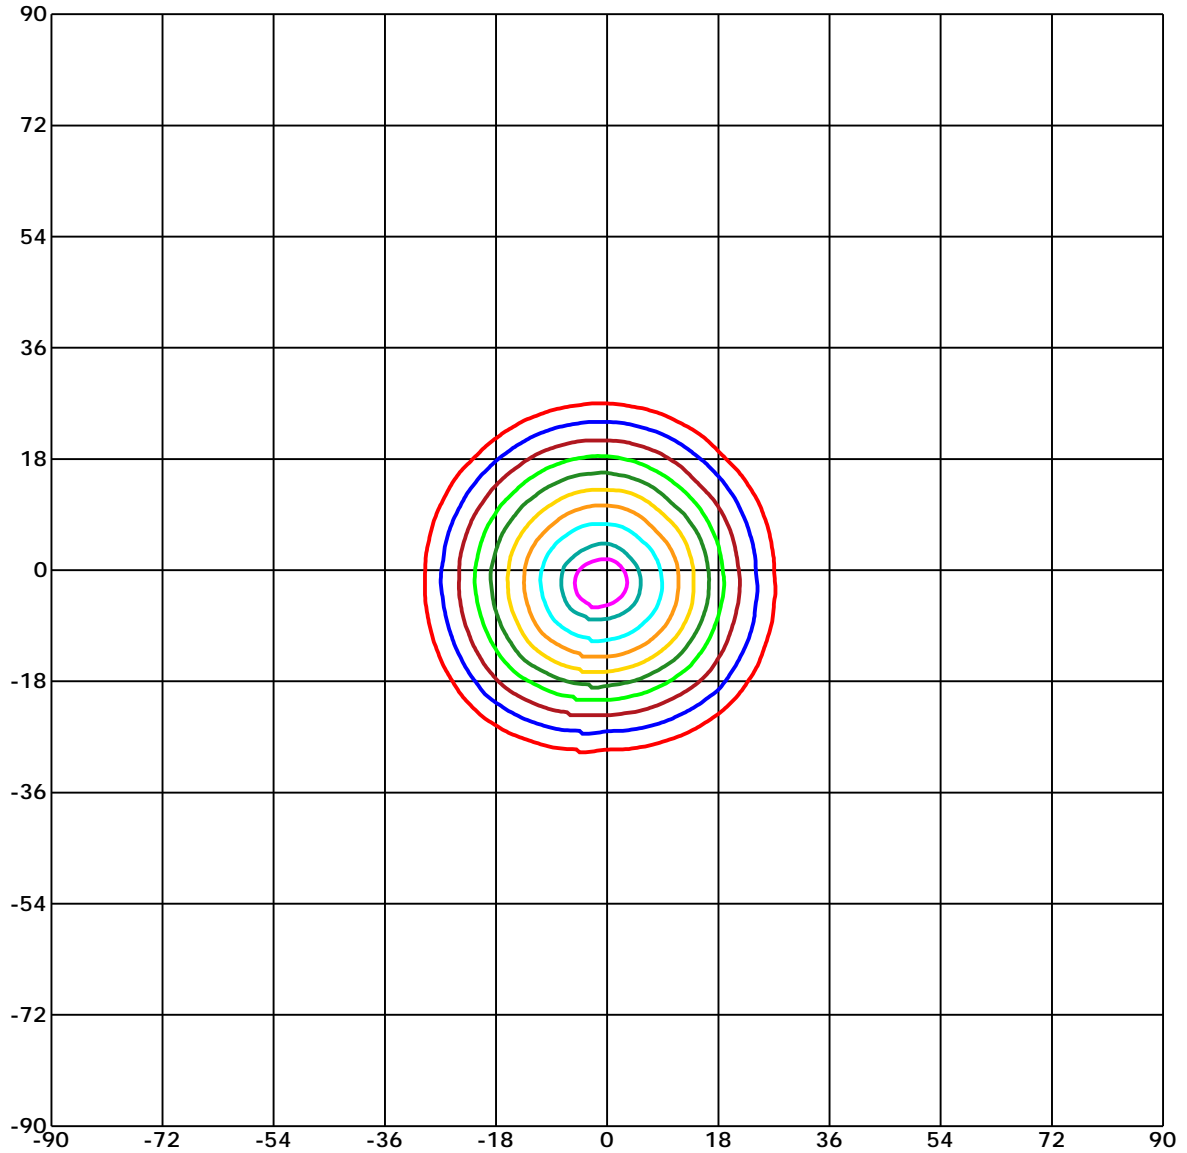

Unit of intensity:cd $I_{max}(100\%)$: 2573.85 cd

- | | |
|----------------------------|----------------------------|
| — 2445.157(95% I_{max}) | — 1286.925(50% I_{max}) |
| — 2316.465(90% I_{max}) | — 1029.54(40% I_{max}) |
| — 2059.08(80% I_{max}) | — 772.155(30% I_{max}) |
| — 1801.695(70% I_{max}) | — 514.77(20% I_{max}) |
| — 1544.31(60% I_{max}) | — 257.385(10% I_{max}) |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

ISOCANDELA DIAGRAM (SPHERE)

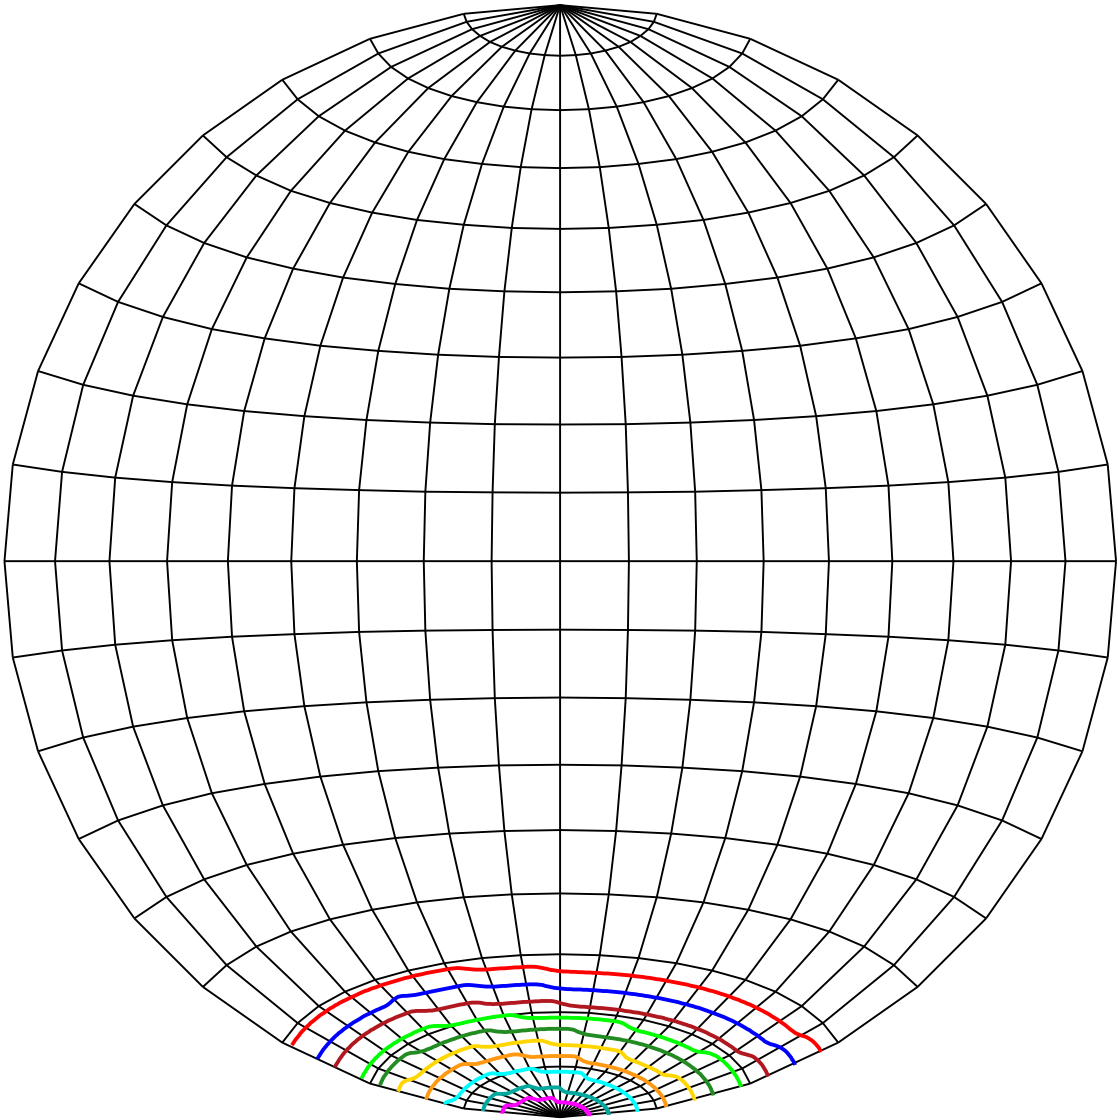

Unit of intensity:cd I_{max}(100%): 2573.85 cd

- | | |
|----------------------------------|----------------------------------|
| — 2445.157(95%I _{max}) | — 1286.925(50%I _{max}) |
| — 2316.465(90%I _{max}) | — 1029.54(40%I _{max}) |
| — 2059.08(80%I _{max}) | — 772.155(30%I _{max}) |
| — 1801.695(70%I _{max}) | — 514.77(20%I _{max}) |
| — 1544.31(60%I _{max}) | — 257.385(10%I _{max}) |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

ISOLX DIAGRAM

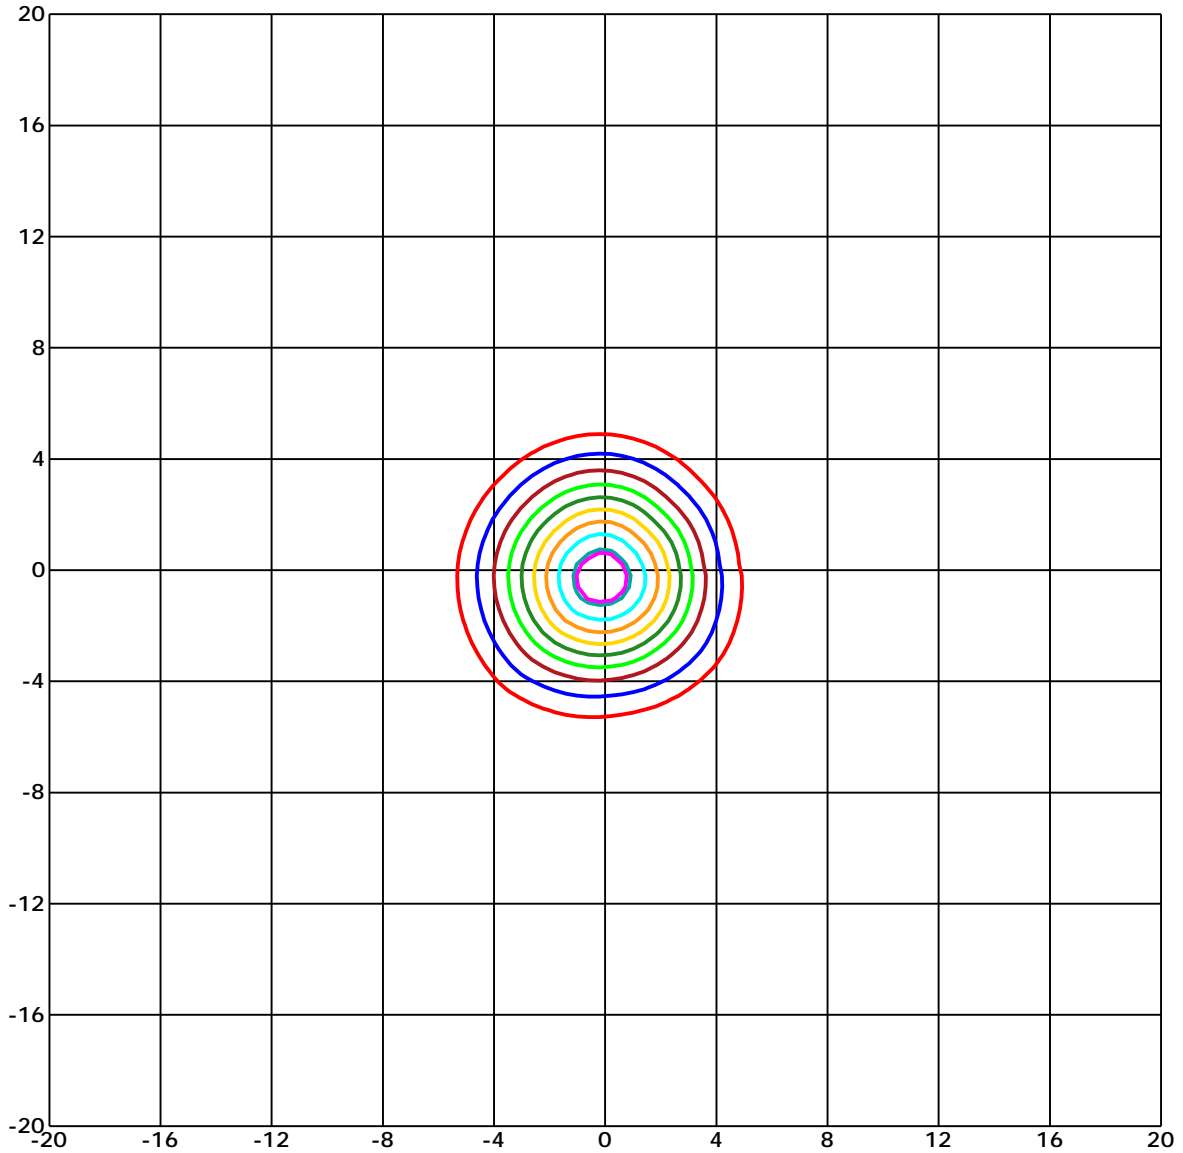

Unit of illumination: lx Height of plane: 10.0(m)/32.81(ft)

— 23.636(1%E _{max})	— 12.846(0%E _{max})
— 23.122(1%E _{max})	— 10.277(0%E _{max})
— 20.553(1%E _{max})	— 7.707(0%E _{max})
— 17.984(1%E _{max})	— 5.138(0%E _{max})
— 15.415(1%E _{max})	— 2.569(0%E _{max})

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

UTILIZATION FACTOR DIAGRAM (ROAD)

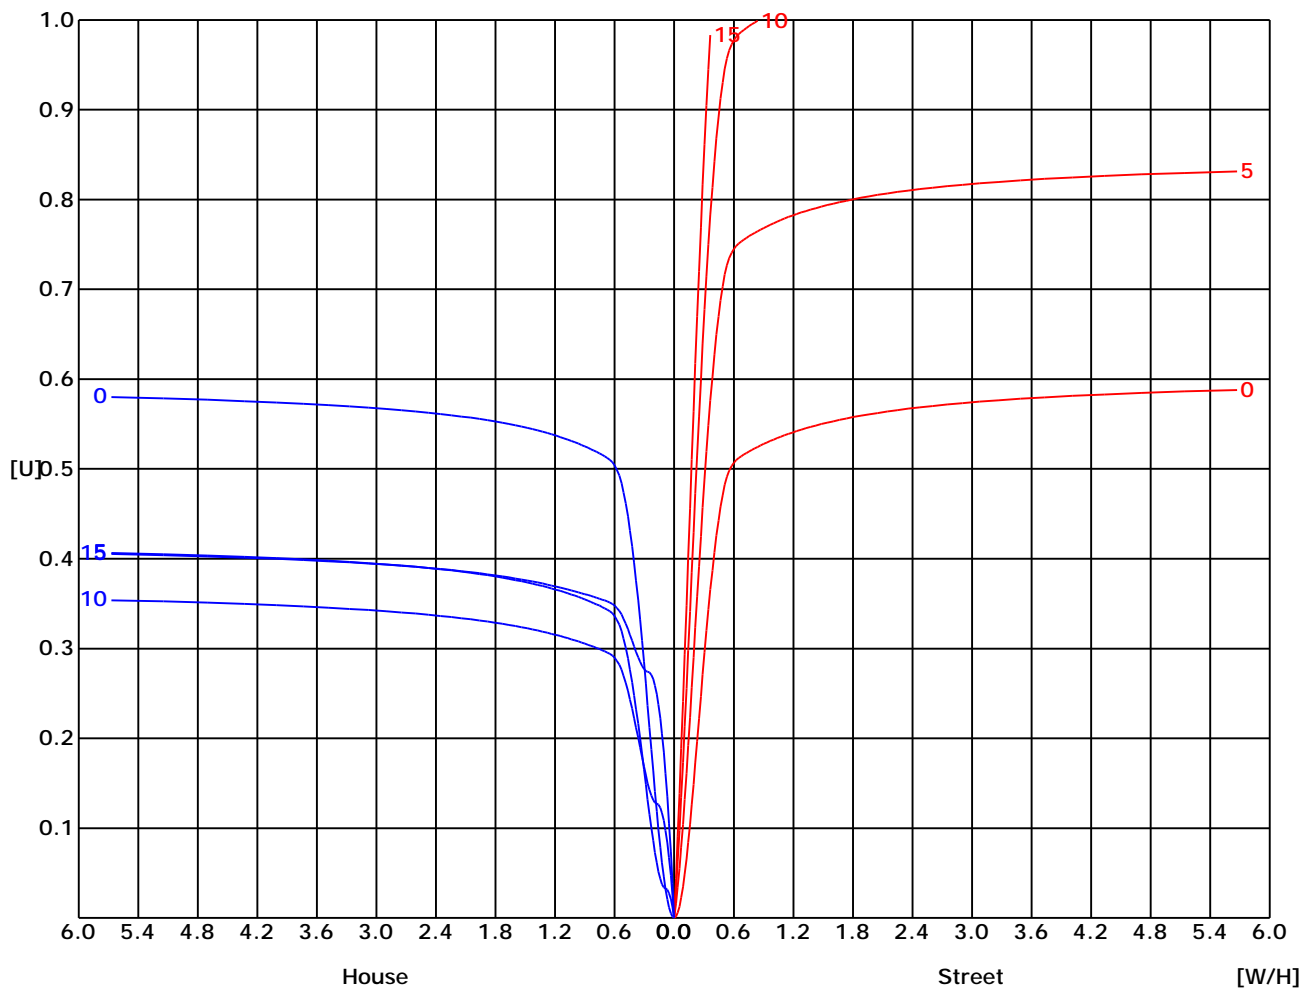

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32


G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

BRIGHT LIMIT DIAGRAM

C/G	45	50	55	60	65	70	75	80	85
C0	1149	1145	1213	1332	1569	1896	2435	3614	7220
C90	1191	1178	1237	1364	1549	1840	2604	3572	7168
Dazzle	Quality	Illuminance	---	---	---	---	---	---	---
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
---	---	a	b	c	d	e	f	g	h

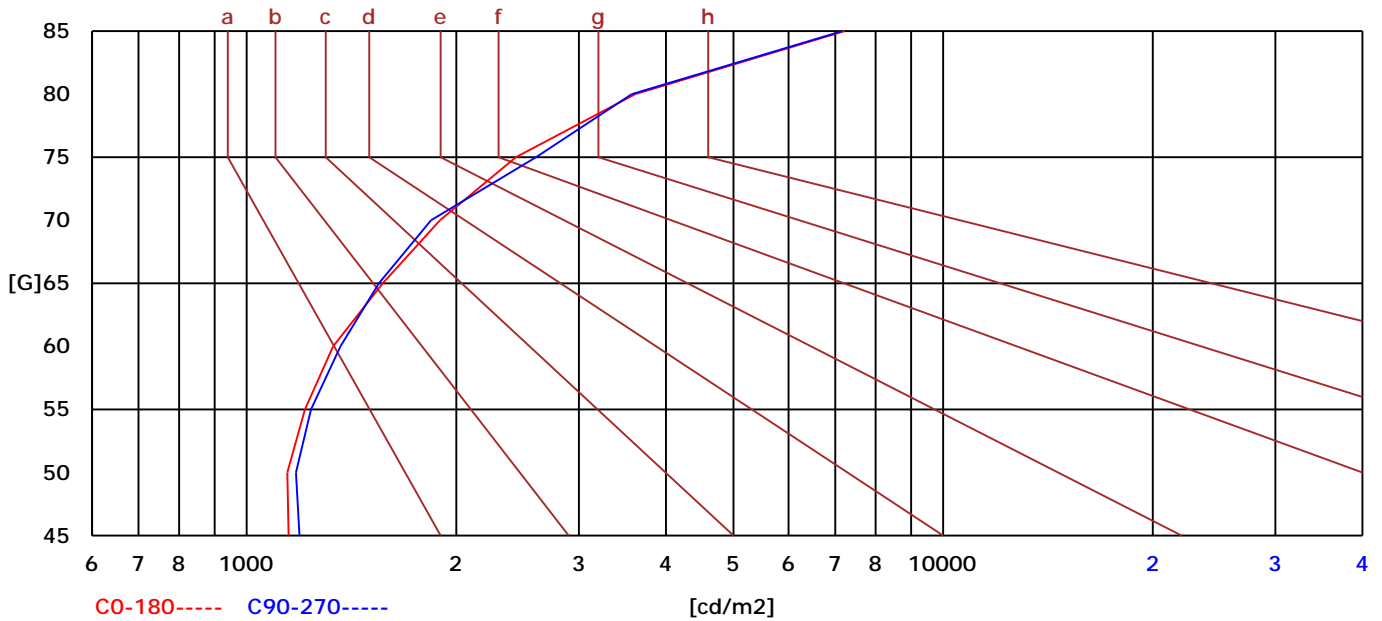


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

LX-DISTANCE DIAGRAM

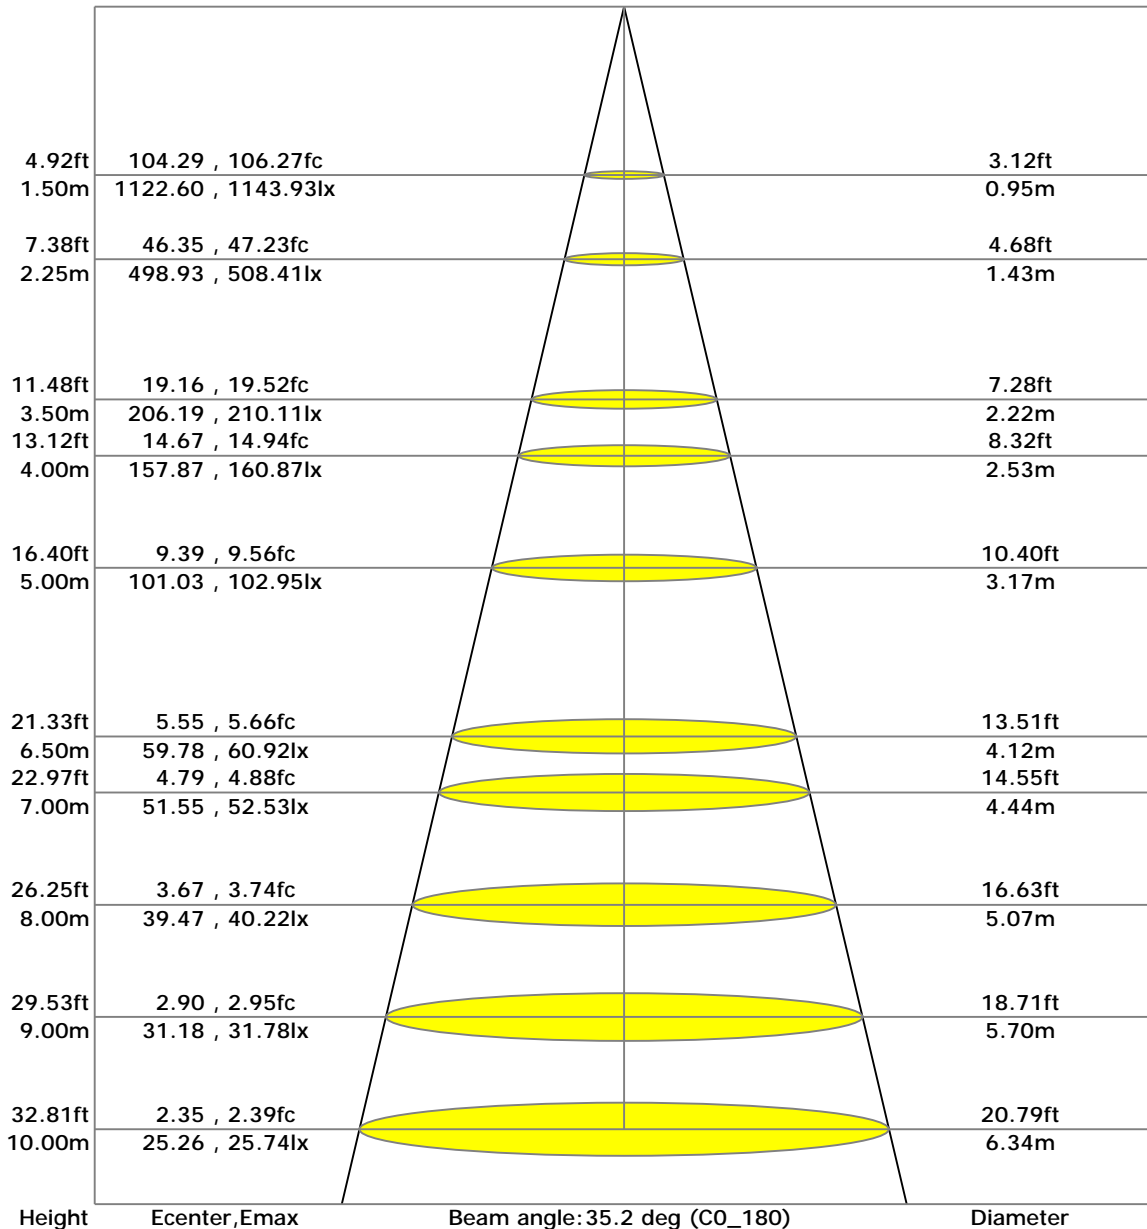

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

UGR(Unified Glare Rating) TABLE

RHOCC		70	70	50	50	30	70	70	50	50	30
RHOW		50	30	50	30	30	50	30	50	30	30
RHOF		20	20	20	20	20	20	20	20	20	20
Room Size X Y		Viewed Endwise					Viewed Crosswise				
2H	2H	6.28	6.34	6.48	6.53	6.77	6.45	6.51	6.65	6.69	6.94
	3H	6.70	6.76	6.90	6.95	7.19	6.84	6.89	7.04	7.09	7.33
	4H	6.86	6.92	7.07	7.12	7.37	6.99	7.04	7.20	7.24	7.49
	6H	6.96	7.02	7.17	7.22	7.47	7.07	7.13	7.29	7.33	7.58
	8H	6.95	7.01	7.17	7.21	7.46	7.06	7.12	7.28	7.33	7.58
	12H	6.94	7.00	7.16	7.20	7.46	7.05	7.11	7.28	7.32	7.57
4H	2H	11.19	11.24	11.40	11.44	11.69	11.41	11.47	11.62	11.66	11.91
	3H	11.89	11.95	12.11	12.16	12.41	12.08	12.14	12.30	12.34	12.60
	4H	12.21	12.27	12.44	12.48	12.74	12.37	12.43	12.60	12.64	12.90
	6H	12.46	12.51	12.69	12.73	13.00	12.61	12.66	12.84	12.88	13.15
	8H	12.55	12.61	12.79	12.83	13.10	12.68	12.74	12.93	12.97	13.23
	12H	12.59	12.65	12.84	12.88	13.15	12.72	12.78	12.97	13.01	13.28
8H	4H	14.15	14.20	14.36	14.41	14.66	14.44	14.50	14.66	14.70	14.96
	6H	16.17	16.23	16.43	16.47	16.74	16.40	16.45	16.65	16.69	16.96
	8H	16.41	16.46	16.67	16.70	16.98	16.61	16.66	16.87	16.91	17.18
	12H	16.60	16.65	16.87	16.90	17.18	16.78	16.83	17.05	17.09	17.37
12H	4H	17.10	17.15	17.35	17.38	17.65	17.35	17.40	17.60	17.63	17.90
	6H	17.78	17.83	18.04	18.07	18.35	18.00	18.05	18.26	18.30	18.57

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

ZONAL LUMINOUS FLUX TABLE

Gamma [deg]	I _{mean} [cd]	Zonal Flux [lm]	Sum Flux [lm]	Zonal Flux [%]	Sum Flux [%]
0	2527.83	0.00	0.00	0.00	0.00
5	2428.07	58.60	58.60	5.59	5.59
10	2096.15	156.54	215.15	14.94	20.53
15	1629.88	208.76	423.90	19.92	40.45
20	1113.75	207.22	631.12	19.77	60.22
25	638.52	161.12	792.24	15.37	75.60
30	211.96	83.26	875.50	7.94	83.54
35	53.19	23.58	899.08	2.25	85.79
40	40.97	14.46	913.54	1.38	87.17
45	36.56	13.91	927.45	1.33	88.50
50	32.18	13.42	940.87	1.28	89.78
55	29.56	13.20	954.07	1.26	91.04
60	27.99	13.13	967.20	1.25	92.29
65	26.56	13.04	980.24	1.24	93.54
70	25.50	13.11	993.36	1.25	94.79
75	25.08	13.35	1006.71	1.27	96.06
80	25.34	13.70	1020.41	1.31	97.37
85	25.42	13.82	1034.23	1.32	98.69
90	25.14	13.76	1047.99	1.31	100.00


C Range: 0 - 360 Deg
C Interval: 45.0 Deg
Test Speed: High
Temperature:
Operators:
Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
G Interval: 1.0 Deg
Test System: Huipu CPM-1800B Goniophotometer
Humidity:
Test Distance: 6.04 m
Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

SPACE ISOLX DIAGRAM

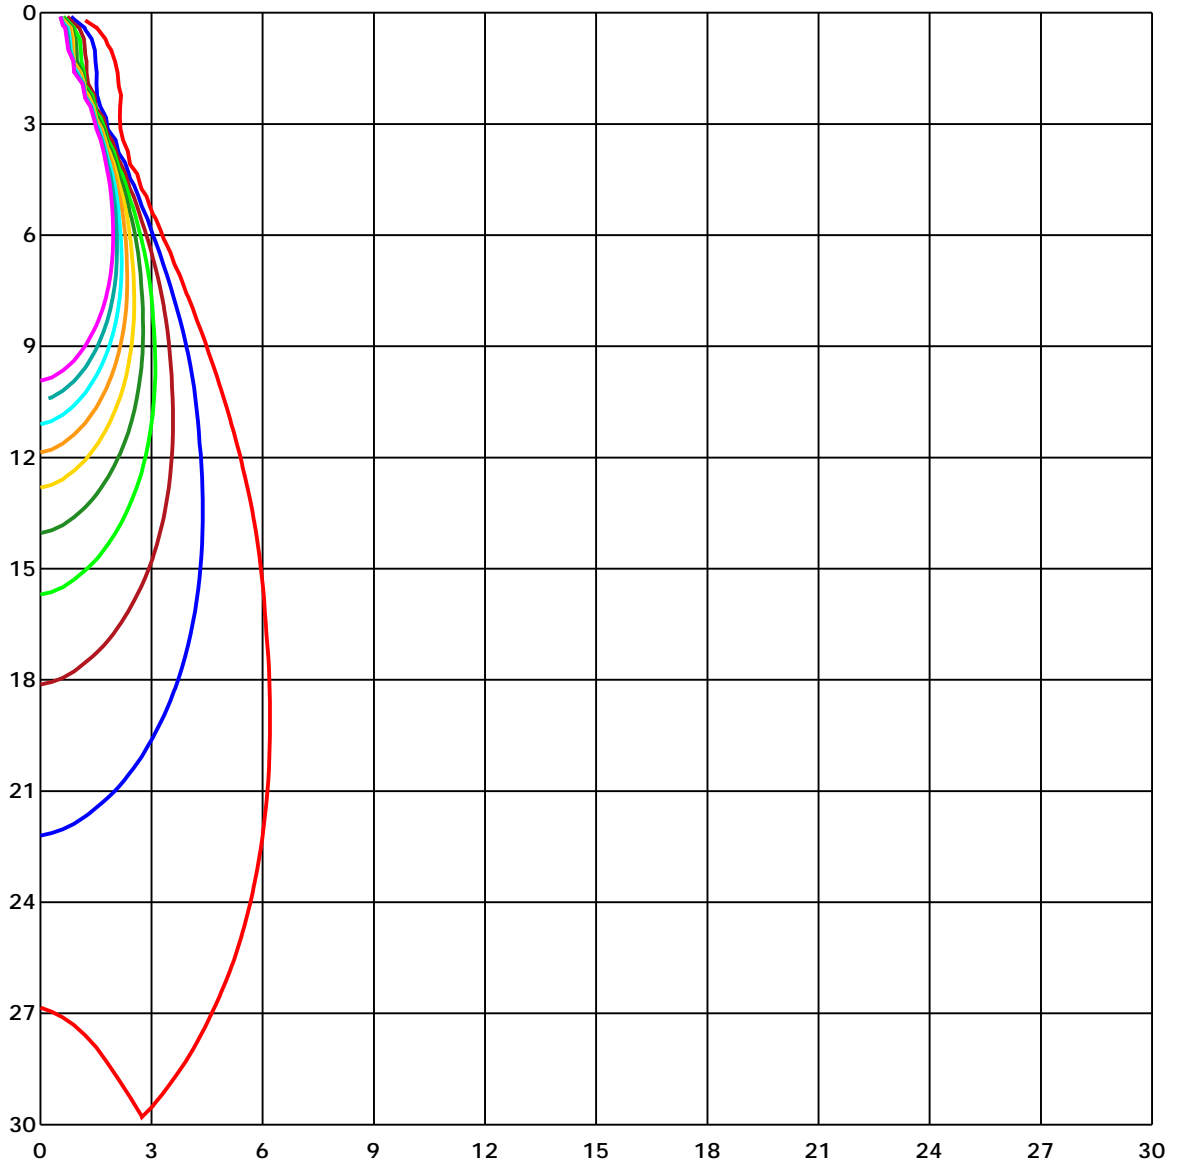

Unit of illumination: lx

- | | |
|----------|----------|
| — 25.624 | — 12.812 |
| — 23.061 | — 10.249 |
| — 20.499 | — 7.687 |
| — 17.937 | — 5.125 |
| — 15.374 | — 2.562 |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:

Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

LUMINOUS DISTRIBUTION INTENSITY DATA

GammaC	C0	C45	C90	C135	C180	C225	C270	C315	C360
G0	2525.84	2535.0	2531.02	2519.46	2525.84	2535.0	2531.02	2519.46	2525.84
G1	2507.31	2497.39	2496.0	2498.3	2531.39	2561.15	2550.25	2528.43	2507.31
G2	2478.05	2449.63	2455.83	2466.78	2524.71	2573.85	2556.48	2520.62	2478.05
G3	2432.92	2390.68	2407.86	2426.17	2508.33	2570.38	2545.54	2495.52	2432.92
G4	2376.63	2325.23	2355.0	2374.0	2470.9	2551.6	2513.0	2458.17	2376.63
G5	2320.27	2252.3	2289.88	2319.87	2430.48	2517.92	2473.85	2414.57	2320.27
G6	2257.19	2175.84	2215.82	2262.99	2384.62	2468.97	2431.94	2363.64	2257.19
G7	2179.99	2083.46	2136.0	2192.11	2330.41	2412.31	2376.78	2296.74	2179.99
G8	2102.25	2001.34	2052.71	2110.06	2263.65	2356.75	2303.16	2227.64	2102.25
G9	2015.5	1907.15	1963.08	2024.69	2182.33	2288.93	2234.28	2153.25	2015.5
G10	1925.94	1812.48	1871.65	1934.51	2100.5	2208.12	2155.77	2072.23	1925.94
G11	1832.65	1717.77	1778.22	1840.1	2013.16	2125.56	2070.59	1985.69	1832.65
G12	1736.34	1613.07	1682.64	1745.61	1920.76	2037.21	1978.18	1893.83	1736.34
G13	1630.14	1513.18	1586.99	1649.26	1826.12	1949.5	1883.98	1796.35	1630.14
G14	1526.06	1404.91	1487.28	1555.98	1731.53	1854.21	1785.74	1693.37	1526.06
G15	1416.03	1294.15	1384.66	1460.65	1635.47	1756.01	1681.69	1584.91	1416.03
G16	1307.1	1197.33	1284.85	1363.68	1537.7	1660.72	1571.7	1475.9	1307.1
G17	1195.54	1095.62	1185.8	1263.91	1441.28	1557.11	1457.08	1365.21	1195.54
G18	1081.83	993.54	1089.49	1169.97	1341.9	1447.08	1345.11	1256.13	1081.83
G19	977.31	894.57	994.71	1075.41	1246.03	1342.09	1231.0	1148.92	977.31
G20	865.82	795.99	898.21	979.53	1146.25	1243.07	1116.48	1041.11	865.82
G21	774.76	713.07	803.95	882.49	1047.82	1136.15	1005.07	943.63	774.76
G22	685.89	629.85	714.89	786.62	952.24	1036.15	888.29	851.19	685.89
G23	598.88	539.13	632.66	698.66	853.89	941.44	790.34	777.13	598.88
G24	505.63	446.43	539.67	602.42	759.33	851.26	701.5	701.91	505.63
G25	415.85	360.26	449.31	511.51	672.1	767.72	606.94	613.77	415.85
G26	327.06	274.52	354.89	415.05	573.38	685.02	507.71	515.52	327.06
G27	247.38	199.99	273.61	322.75	473.71	588.89	415.6	424.24	247.38
G28	172.52	135.86	196.45	239.21	377.51	489.07	328.19	333.73	172.52
G29	119.7	86.24	134.07	169.38	287.44	396.19	251.18	251.47	119.7
G30	76.17	61.25	85.66	113.09	207.8	310.71	181.5	180.33	76.17
G31	58.88	53.7	62.89	72.2	143.7	236.98	124.8	122.69	58.88
G32	52.9	49.47	55.89	55.16	94.96	172.08	85.91	79.09	52.9
G33	48.85	46.44	51.22	49.98	63.11	118.89	57.68	61.29	48.85
G34	46.19	44.4	48.45	46.66	55.56	78.18	51.15	54.9	46.19
G35	44.0	42.54	46.08	45.09	50.31	58.77	47.64	51.66	44.0
G36	42.36	41.15	44.18	43.23	47.5	53.45	45.42	51.04	42.36

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:

Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

LUMINOUS DISTRIBUTION INTENSITY DATA(Continue 1)

GammaC	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G37	40.53	39.73	42.68	40.86	45.46	50.24	43.52	46.66	40.53	
G38	39.51	38.78	41.33	39.62	43.67	47.68	42.25	44.69	39.51	
G39	38.16	37.58	42.76	38.52	42.14	45.86	39.55	43.23	38.16	
G40	37.17	36.81	39.25	37.54	43.19	44.29	40.24	42.03	37.17	
G41	36.37	35.97	40.53	36.7	42.28	42.98	39.51	40.71	36.37	
G42	35.46	34.91	37.32	35.97	38.89	41.66	36.08	39.36	35.46	
G43	34.58	34.15	36.26	35.31	38.05	40.6	37.87	40.42	34.58	
G44	35.9	33.42	35.31	36.55	37.03	39.73	37.07	37.47	35.9	
G45	32.87	32.51	34.58	33.67	36.34	38.74	32.83	36.45	32.87	
G46	32.18	31.63	35.75	32.98	35.57	37.94	35.61	35.5	32.18	
G47	31.08	31.12	33.02	32.4	34.58	34.51	34.77	34.66	31.08	
G48	30.57	30.64	34.11	31.48	33.89	36.41	34.26	33.53	30.57	
G49	30.02	29.91	31.92	30.54	33.13	35.39	33.56	32.94	30.02	
G50	29.29	29.44	31.59	30.28	32.54	30.9	32.94	32.25	29.29	
G51	28.75	28.78	31.08	29.81	33.6	34.0	32.1	31.63	28.75	
G52	30.32	28.53	30.61	29.4	32.4	33.42	31.45	31.05	30.32	
G53	27.87	28.31	30.32	28.89	30.64	32.72	30.79	30.5	27.87	
G54	27.47	27.87	30.21	28.82	30.32	32.03	27.87	31.88	27.47	
G55	27.14	27.84	29.88	28.38	29.81	31.59	29.73	29.4	27.14	
G56	28.89	27.58	29.59	26.23	29.7	31.01	29.29	29.04	28.89	
G57	26.67	27.25	29.19	25.79	29.33	30.54	28.75	28.67	26.67	
G58	26.16	27.03	28.86	27.91	28.97	30.13	28.42	28.16	26.16	
G59	25.94	27.0	28.42	27.8	28.97	29.66	27.98	28.13	25.94	
G60	27.4	26.63	27.8	27.29	28.42	29.22	27.76	29.81	27.4	
G61	25.25	26.56	27.03	27.18	27.87	28.86	27.94	27.58	25.25	
G62	24.84	26.56	26.78	26.78	27.73	28.42	26.85	27.18	24.84	
G63	24.66	26.63	26.27	26.6	23.35	27.8	27.76	26.7	24.66	
G64	24.59	26.6	26.27	26.45	27.0	27.58	26.01	28.02	24.59	
G65	25.32	26.52	27.22	26.19	26.6	26.85	25.76	26.7	25.32	
G66	24.7	26.45	25.97	26.27	26.52	26.74	25.72	27.65	24.7	
G67	24.77	26.3	26.05	25.83	26.12	26.74	25.46	26.34	24.77	
G68	24.59	26.23	25.79	25.57	26.01	26.38	25.39	26.41	24.59	
G69	23.53	25.9	25.54	25.35	25.72	26.23	25.35	26.34	23.53	
G70	23.64	25.94	25.72	25.17	25.68	26.7	25.39	26.52	23.64	
G71	24.92	25.94	25.5	25.21	25.43	25.94	25.28	26.27	24.92	
G72	24.66	25.72	25.68	24.92	25.21	26.19	27.11	26.3	24.66	
G73	24.77	25.57	25.61	24.99	25.25	26.01	25.28	26.19	24.77	

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 16:00:32

LUMINOUS DISTRIBUTION INTENSITY DATA(Continue 2)

Gamma\C	C0	C45	C90	C135	C180	C225	C270	C315	C360
G74	24.63	25.39	25.72	25.17	25.06	25.9	25.25	23.49	24.63
G75	24.7	25.21	27.58	26.96	27.29	25.83	25.32	26.27	24.7
G76	24.92	25.25	25.57	25.03	27.07	25.72	25.14	26.49	24.92
G77	24.63	25.14	25.46	26.85	25.21	25.65	25.35	26.52	24.63
G78	24.95	27.07	25.61	26.89	25.17	25.83	25.06	26.41	24.95
G79	24.92	25.17	25.46	24.81	25.28	25.57	25.25	26.27	24.92
G80	24.99	25.1	25.57	24.81	24.99	25.68	25.21	22.8	24.99
G81	24.88	25.06	25.68	24.7	26.85	27.62	25.14	26.52	24.88
G82	20.94	25.06	25.76	25.03	25.06	27.58	25.1	26.45	20.94
G83	24.92	25.06	25.9	24.92	26.89	25.61	25.35	26.49	24.92
G84	24.99	25.21	26.12	24.7	25.14	25.61	25.28	26.34	24.99
G85	24.88	25.17	26.16	24.99	25.06	25.5	25.35	26.23	24.88
G86	24.81	25.17	26.56	24.88	24.99	25.5	25.25	26.45	24.81
G87	21.82	25.1	26.34	24.77	24.92	27.54	25.14	26.16	21.82
G88	23.97	25.39	25.35	26.08	25.32	26.38	25.57	25.1	23.97
G89	23.64	22.76	25.25	26.38	25.1	26.56	26.19	25.25	23.64
G90	26.02	23.67	0.0	24.38	28.04	26.56	27.32	25.25	26.02

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 16:00:32

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks: