

Report No.:

Test Time: 2022/1/3 15:33:36

LUMINAIRE PHOTOMETRIC TEST REPORT

Luminaire Property

Manufacturer: 0
 Luminaire Type: OJL205 BK
 Lamp Type:
 Luminous Width: 0 mm
 Luminous Length: 0 mm
 Luminous Height: 0 mm


Voltage(V): 109.60 V
 Current(A): 0.1150 A
 Power(W): 12.56 W
 Power Factor: 0.9920
 Lamp Luminous Flux: 1128.49

Photometric Results


CIE Class: Direct
 Luminaire Luminous Flux: 1128.492 lm
 Downward Ratio: 100.00%
 Luminaire Efficacy Rating(LER): 89.85 lm/W
 Beam Angle(50%) C0-180,C90-270: 35.2,34.6
 Field Angle(10%) C0-180,C90-270: 58.4,58.5
 S/MH C0-180,C90-270: 0.573,0.611

Max. Intensity: 2742.83 cd
 Max.Intensity Angle: C=225 Gamma=3
 Upward Ratio: 0.00%
 Efficacy: 100.00%
 Center Intensity: 2637.55 cd
 Effective Luminous Flux: 947.96 lm
 ERP(φ use)(120deg): 1047.67 lm

Picture of Luminaire



Luminous Intensity Distribution Curve

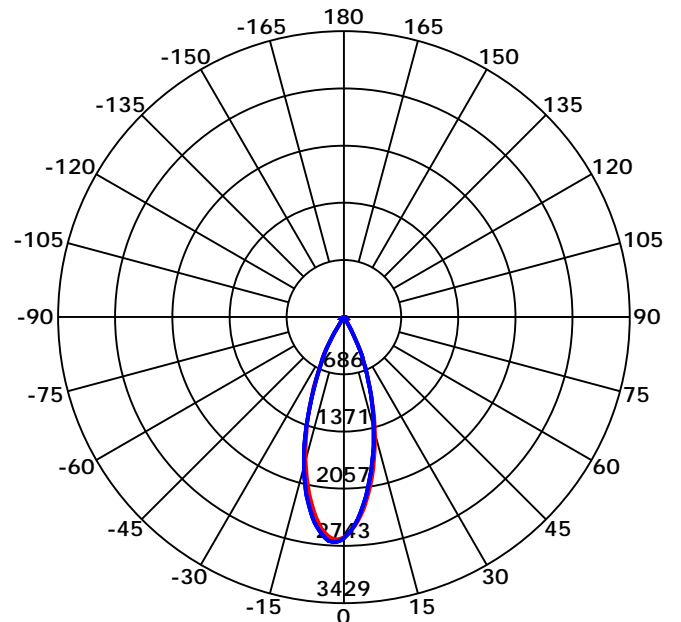

Beam Angle(50%) C0-180,C90-270: 35.2 deg,34.6 deg

C0-180 — C90-270



C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

Luminous Intensity Distribution Curve

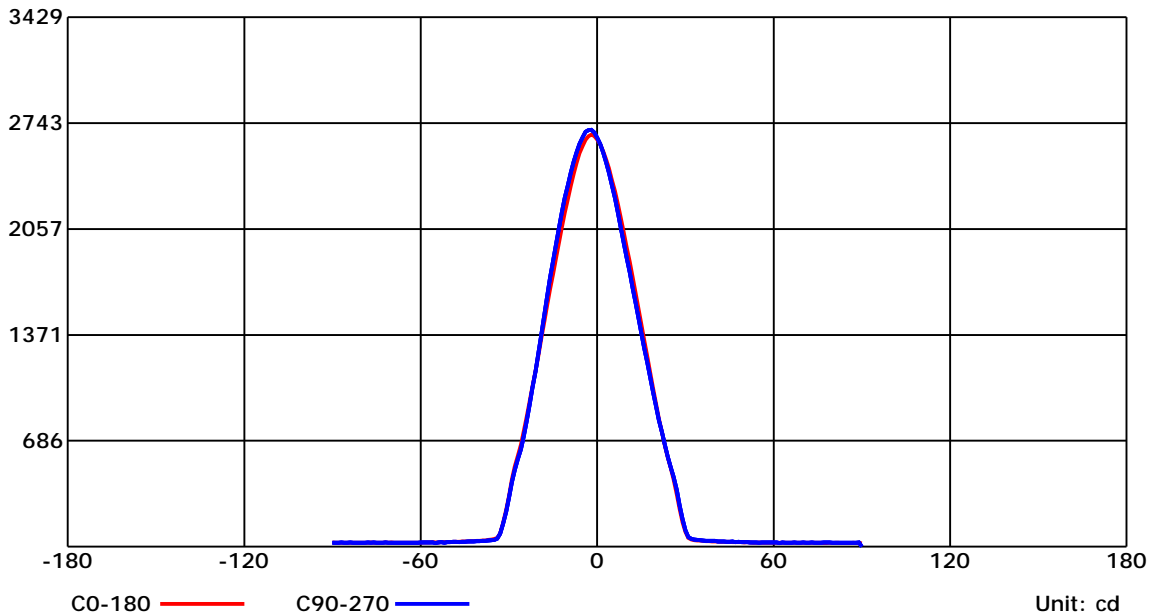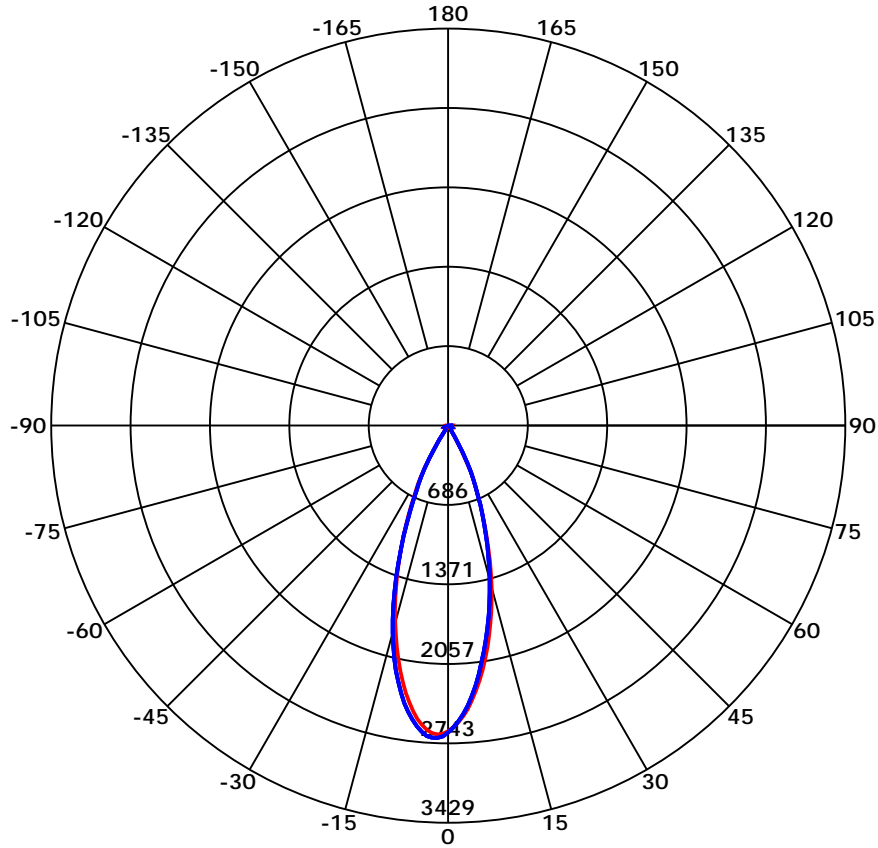


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

Luminous Intensity Distribution Curve

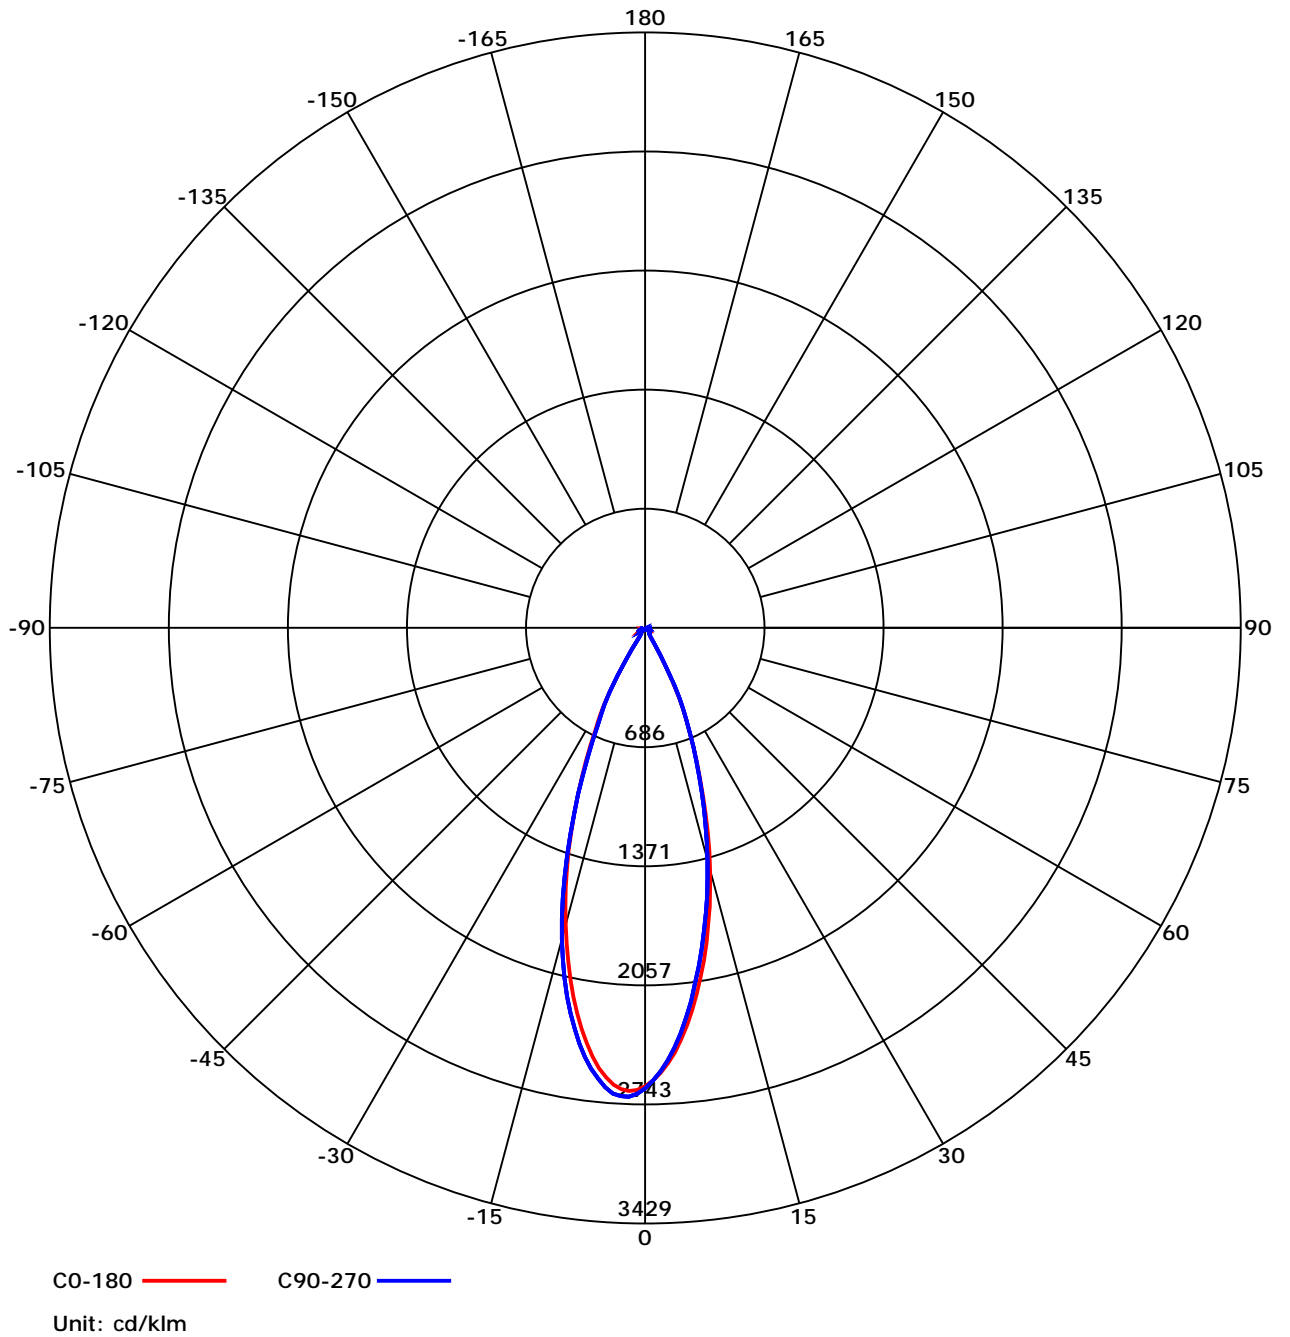

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:


Report No.:

Test Time: 2022/1/3 15:33:36

UTILIZATION FACTORS TABLE

RHOCC	80			70			50			30			10			0
RHOW	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	COEFFICIENTS OF UTILIZATION FOR RHOFC=20															
0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1	0.97	0.94	0.92	0.96	0.93	0.91	0.93	0.90	0.87	0.89	0.85	0.82	0.83	0.80	0.76	0.71
2	0.91	0.89	0.87	0.91	0.88	0.86	0.88	0.85	0.82	0.85	0.81	0.78	0.80	0.76	0.73	0.68
3	0.87	0.85	0.84	0.87	0.84	0.82	0.85	0.81	0.78	0.81	0.78	0.74	0.77	0.73	0.70	0.65
4	0.84	0.82	0.81	0.83	0.81	0.79	0.82	0.78	0.76	0.79	0.75	0.72	0.75	0.71	0.67	0.63
5	0.81	0.80	0.78	0.81	0.78	0.77	0.79	0.76	0.73	0.77	0.73	0.69	0.73	0.69	0.65	0.61
6	0.79	0.77	0.76	0.79	0.76	0.75	0.77	0.74	0.71	0.75	0.71	0.68	0.72	0.67	0.64	0.60
7	0.77	0.76	0.75	0.77	0.74	0.73	0.75	0.72	0.69	0.73	0.69	0.66	0.70	0.66	0.62	0.59
8	0.76	0.74	0.73	0.75	0.73	0.71	0.73	0.70	0.68	0.71	0.67	0.64	0.69	0.64	0.61	0.57
9	0.74	0.73	0.72	0.73	0.71	0.70	0.72	0.69	0.67	0.70	0.66	0.63	0.67	0.63	0.60	0.56
10	0.73	0.71	0.70	0.72	0.70	0.69	0.70	0.67	0.65	0.68	0.65	0.62	0.66	0.62	0.59	0.55

LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

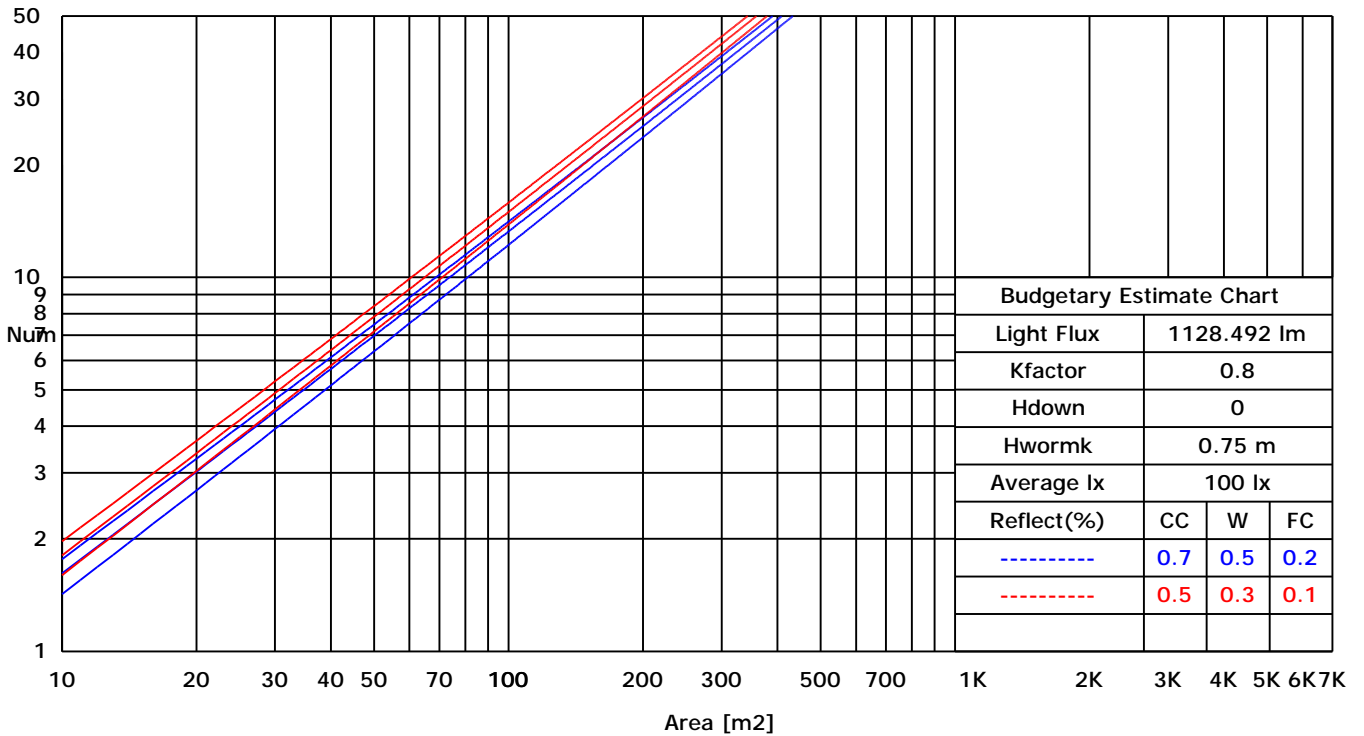


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

ISOCANDELA DIAGRAM (RECTANGULAR)

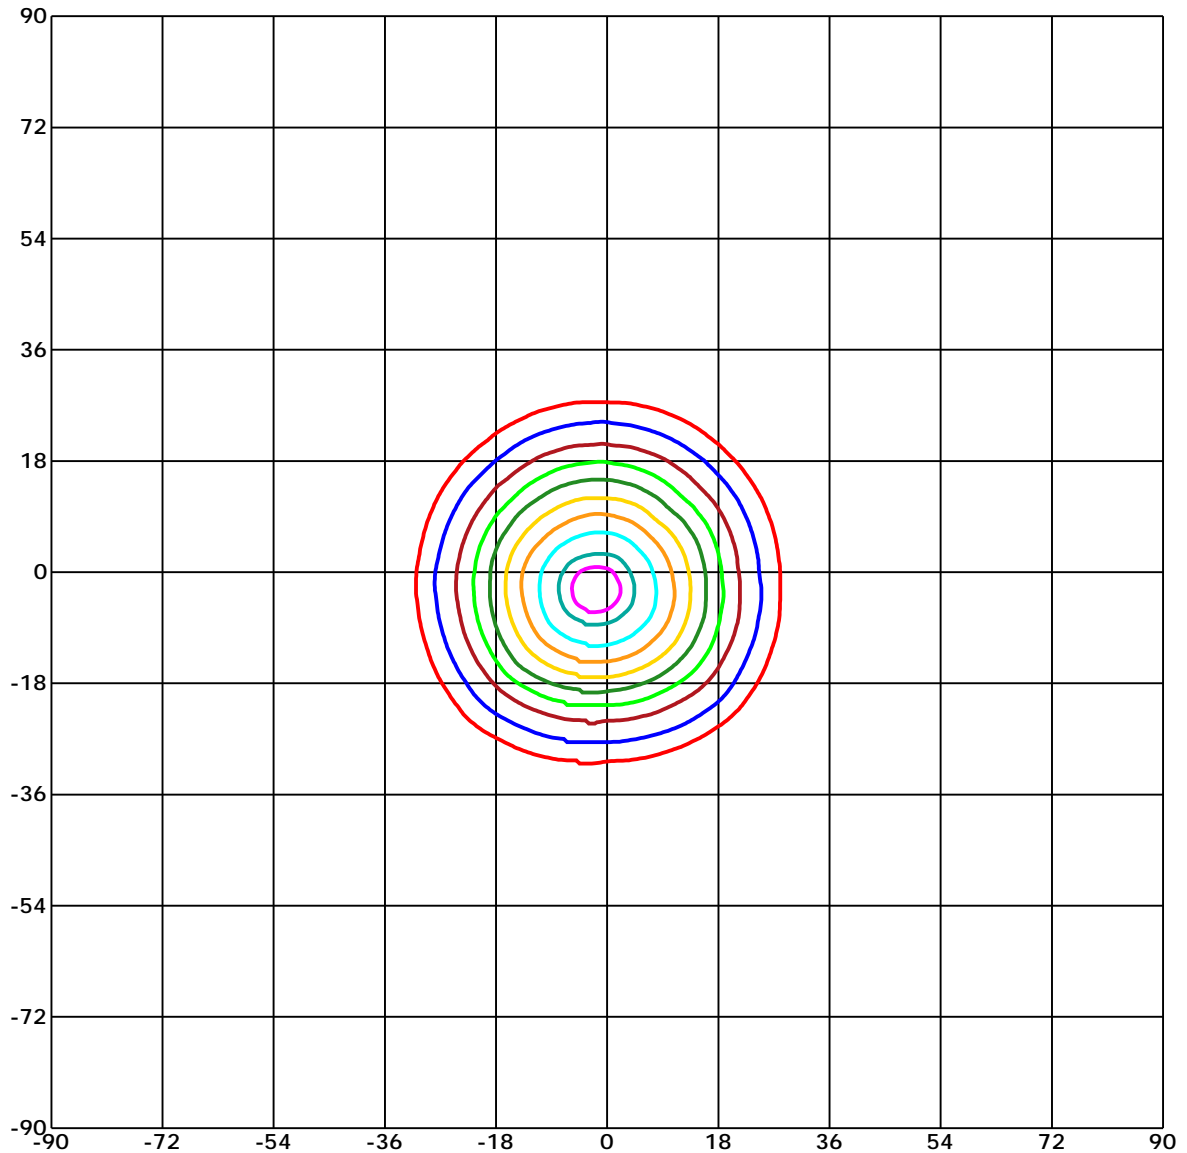

Unit of intensity:cd $I_{max}(100\%)$: 2742.833 cd

- | | |
|----------------------------|----------------------------|
| — 2605.691(95% I_{max}) | — 1371.416(50% I_{max}) |
| — 2468.549(90% I_{max}) | — 1097.133(40% I_{max}) |
| — 2194.266(80% I_{max}) | — 822.85(30% I_{max}) |
| — 1919.983(70% I_{max}) | — 548.567(20% I_{max}) |
| — 1645.7(60% I_{max}) | — 274.283(10% I_{max}) |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

ISOCANDELA DIAGRAM (SPHERE)

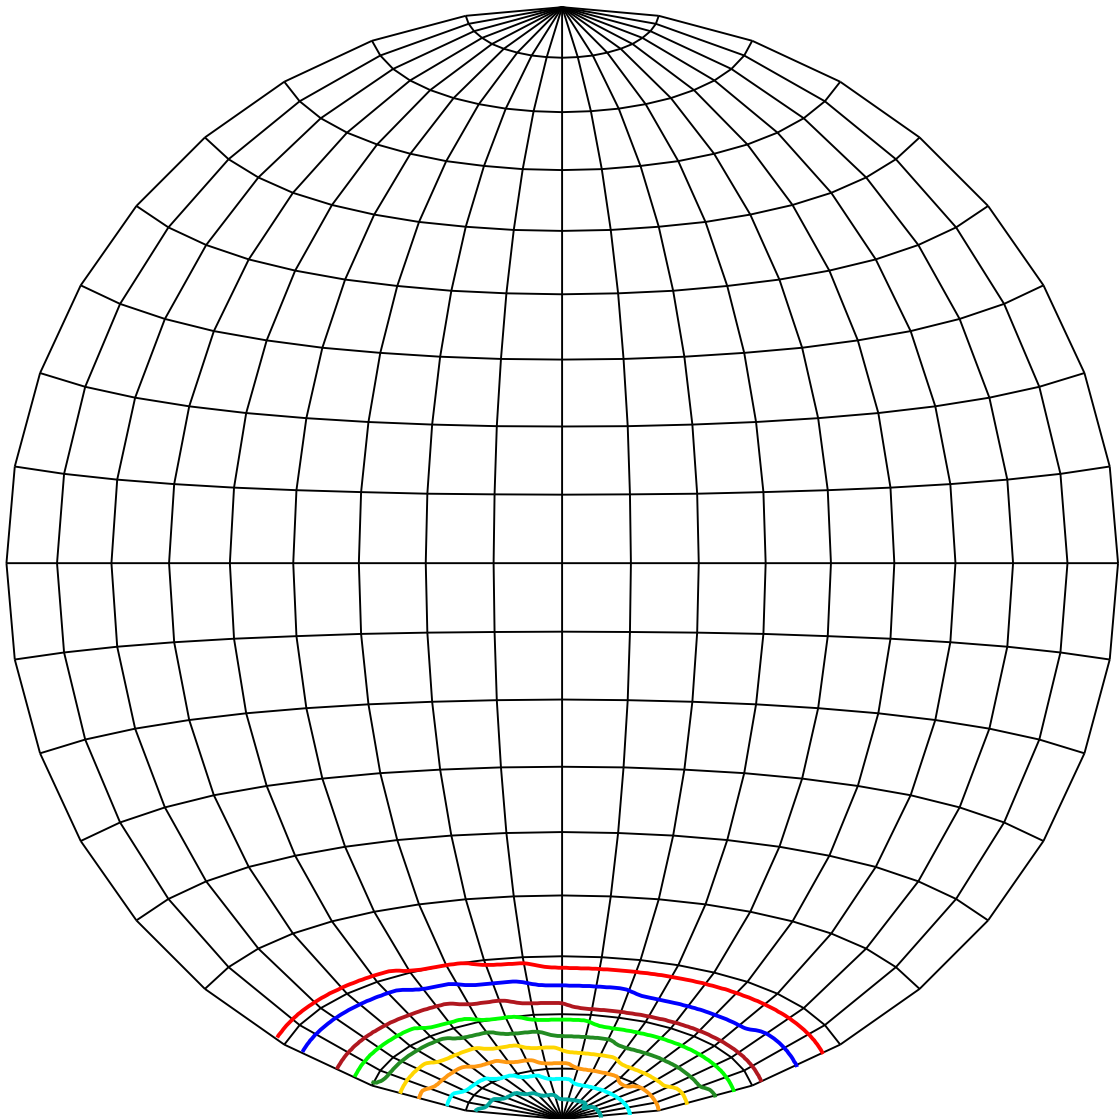

Unit of intensity:cd Imax(100%): 2742.833 cd

- | | |
|---------------------|---------------------|
| — 2605.691(95%Imax) | — 1371.416(50%Imax) |
| — 2468.549(90%Imax) | — 1097.133(40%Imax) |
| — 2194.266(80%Imax) | — 822.85(30%Imax) |
| — 1919.983(70%Imax) | — 548.567(20%Imax) |
| — 1645.7(60%Imax) | — 274.283(10%Imax) |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

ISOLX DIAGRAM

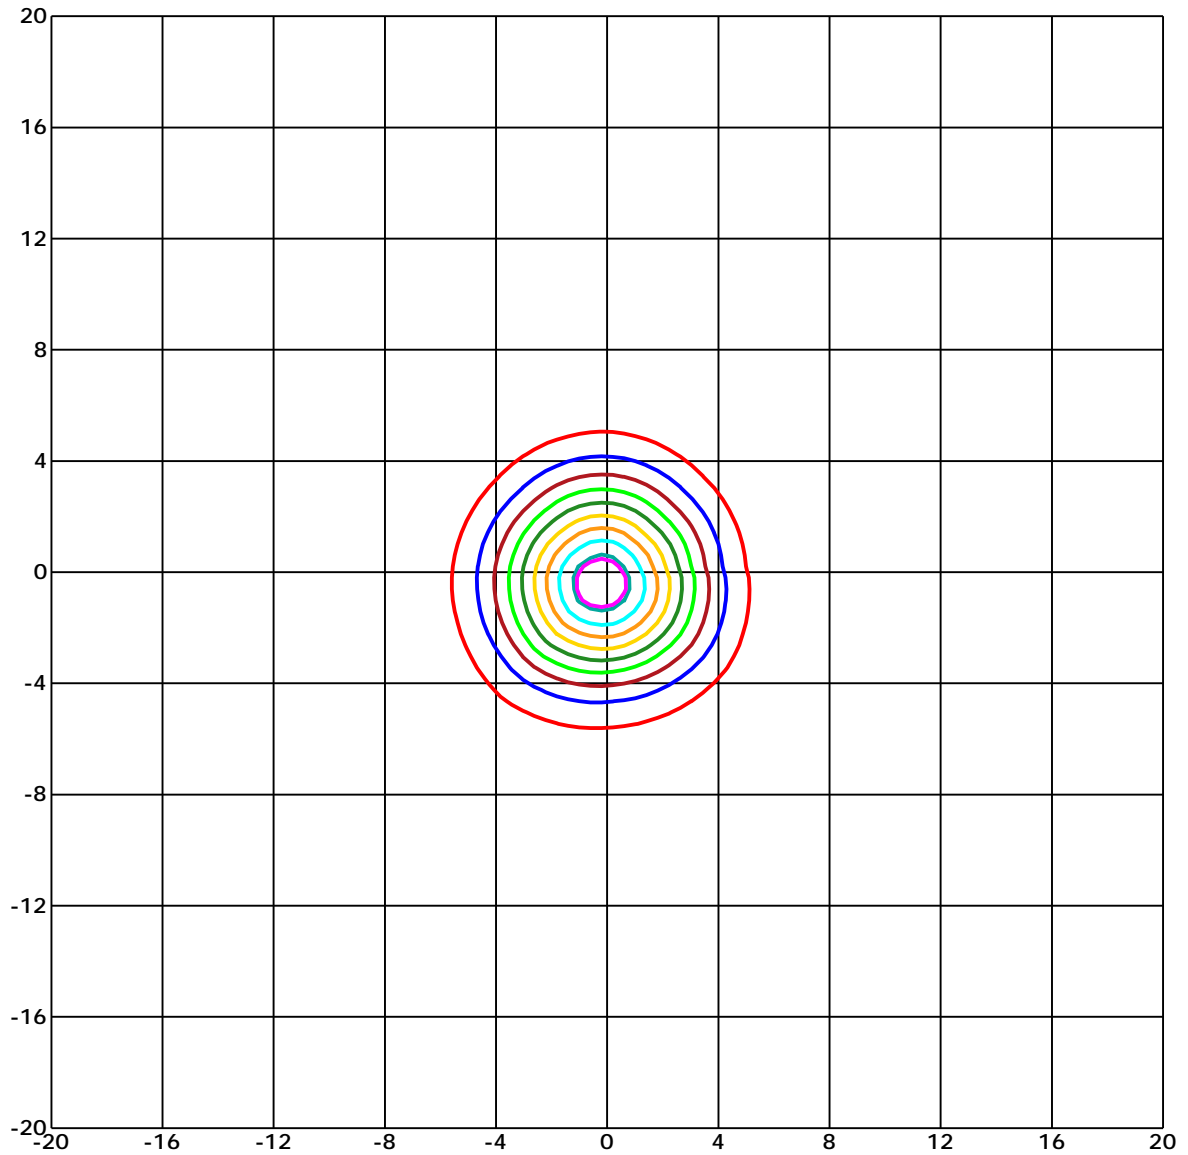

Unit of illumination: lx Height of plane: 10.0(m)/32.81(ft)

- | | |
|-------------------------------|-------------------------------|
| — 25.13(1%E _{max}) | — 13.658(0%E _{max}) |
| — 24.584(1%E _{max}) | — 10.926(0%E _{max}) |
| — 21.853(1%E _{max}) | — 8.195(0%E _{max}) |
| — 19.121(1%E _{max}) | — 5.463(0%E _{max}) |
| — 16.389(1%E _{max}) | — 2.732(0%E _{max}) |

C Range: 0 - 360 Deg

C Interval: 45.0 Deg

Test Speed: High

Temperature:

Operators:

Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg

G Interval: 1.0 Deg

Test System: Huipu CPM-1800B Goniophotometer

Humidity:


Test Distance: 6.04 m

Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

UTILIZATION FACTOR DIAGRAM (ROAD)

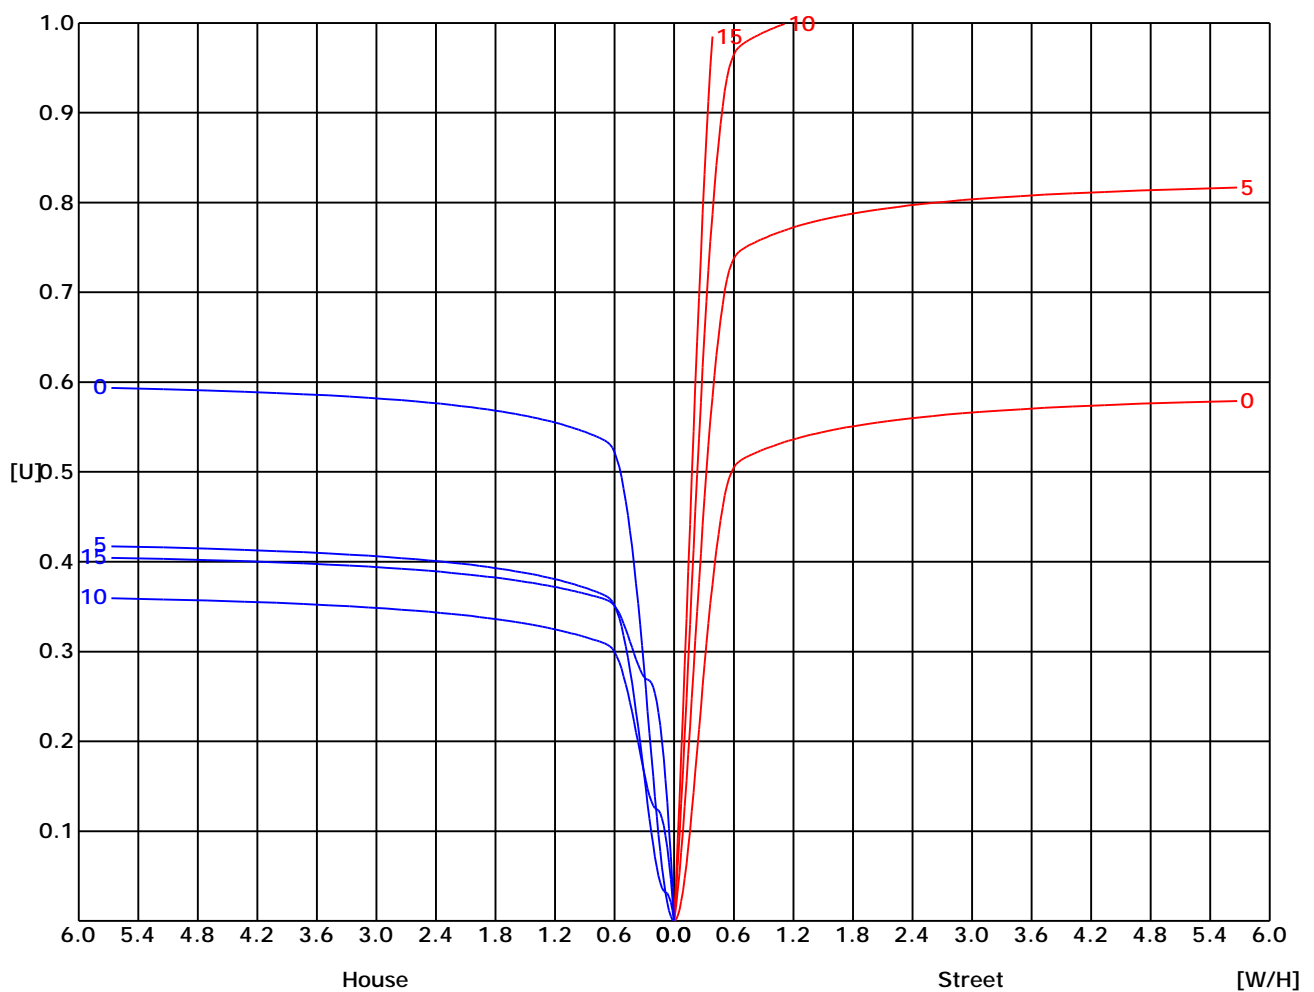

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36


G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

BRIGHT LIMIT DIAGRAM

C/G	45	50	55	60	65	70	75	80	85
C0	1065	1071	1140	1282	1552	1901	2548	3782	7325
C90	1175	1093	1145	1290	1565	1843	2498	3782	7534
Dazzle	Quality	Illuminance	---	---	---	---	---	---	---
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
---	---	a	b	c	d	e	f	g	h

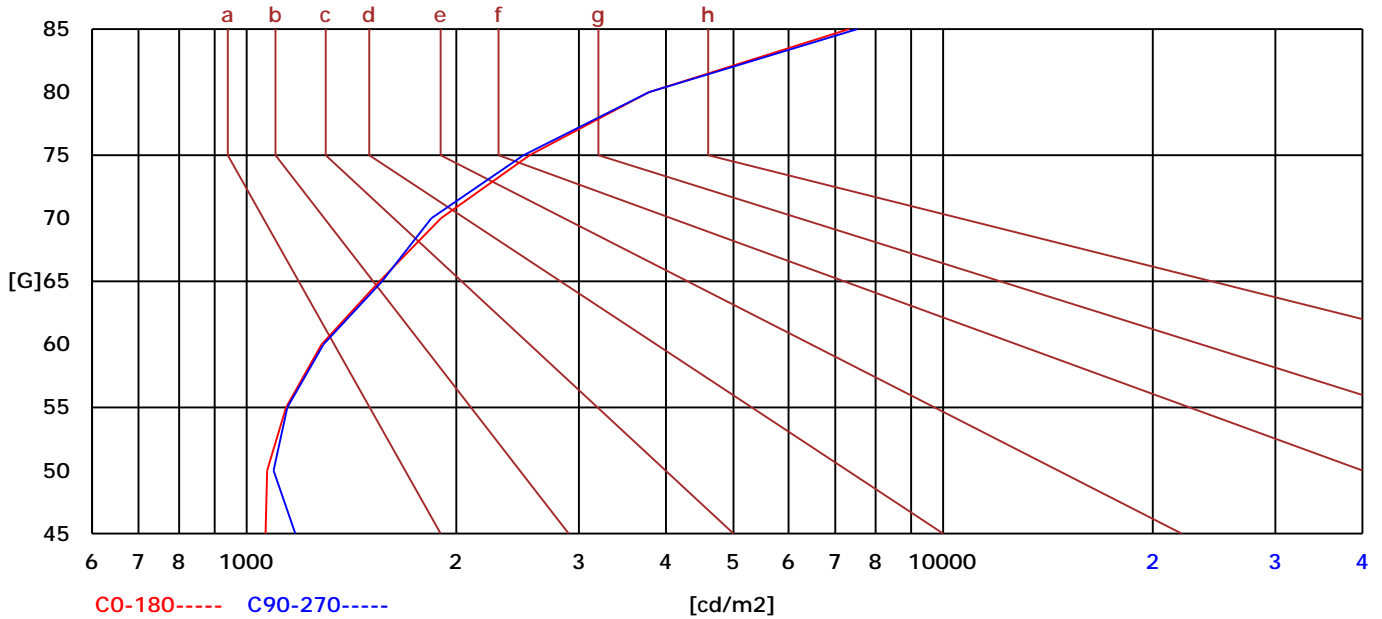


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

LX-DISTANCE DIAGRAM

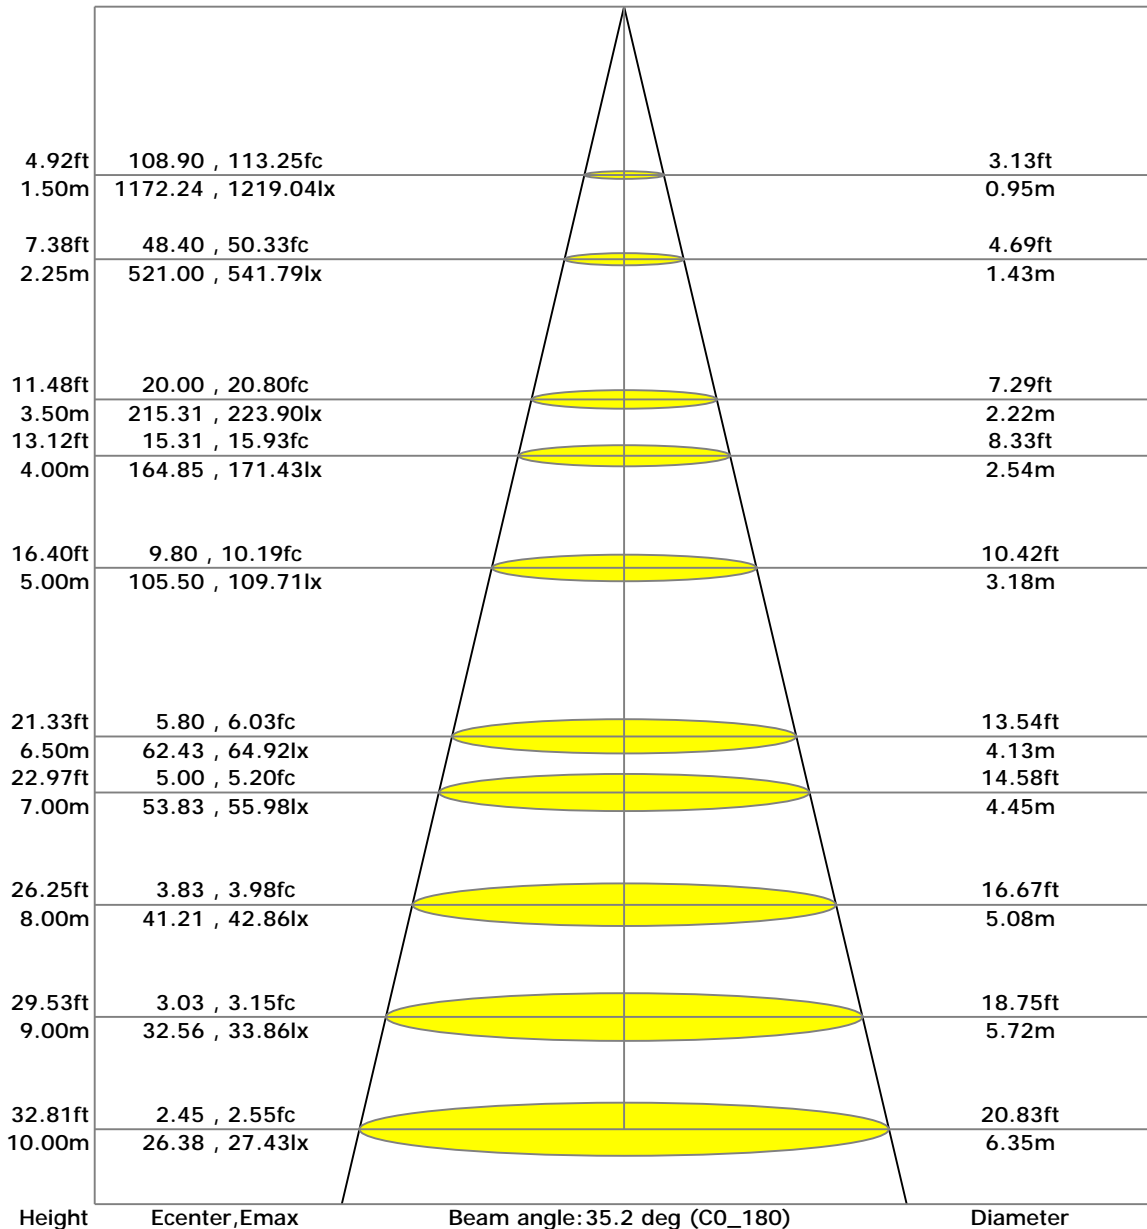

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

UGR(Unified Glare Rating) TABLE

RHOCC		70	70	50	50	30	70	70	50	50	30
RHOW		50	30	50	30	30	50	30	50	30	30
RHOF		20	20	20	20	20	20	20	20	20	20
Room Size X Y		Viewed Endwise					Viewed Crosswise				
2H	2H	5.66	5.72	5.86	5.90	6.15	5.82	5.88	6.02	6.06	6.31
	3H	6.10	6.16	6.31	6.35	6.59	6.23	6.29	6.44	6.48	6.73
	4H	6.28	6.33	6.49	6.53	6.78	6.40	6.45	6.61	6.65	6.90
	6H	6.38	6.44	6.60	6.64	6.89	6.49	6.54	6.70	6.74	7.00
	8H	6.38	6.43	6.59	6.64	6.89	6.48	6.54	6.70	6.74	6.99
	12H	6.37	6.42	6.59	6.63	6.89	6.47	6.53	6.69	6.73	6.99
4H	2H	10.76	10.82	10.97	11.01	11.26	10.94	11.00	11.15	11.19	11.44
	3H	11.49	11.54	11.71	11.75	12.00	11.65	11.70	11.87	11.91	12.16
	4H	11.81	11.87	12.04	12.08	12.34	11.95	12.01	12.18	12.22	12.48
	6H	12.07	12.13	12.31	12.35	12.61	12.19	12.25	12.43	12.47	12.73
	8H	12.16	12.22	12.41	12.44	12.71	12.28	12.34	12.52	12.56	12.83
	12H	12.21	12.26	12.45	12.49	12.76	12.32	12.37	12.57	12.61	12.87
8H	4H	13.86	13.92	14.08	14.12	14.37	14.05	14.11	14.27	14.31	14.57
	6H	15.92	15.97	16.18	16.21	16.49	16.04	16.10	16.30	16.33	16.61
	8H	16.15	16.20	16.41	16.44	16.72	16.26	16.31	16.52	16.56	16.83
	12H	16.33	16.38	16.60	16.63	16.91	16.43	16.48	16.70	16.73	17.01
12H	4H	16.73	16.78	16.98	17.01	17.28	16.92	16.97	17.16	17.20	17.47
	6H	17.41	17.46	17.67	17.70	17.98	17.58	17.63	17.84	17.87	18.15

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

ZONAL LUMINOUS FLUX TABLE

Gamma [deg]	Imean [cd]	Zonal Flux [lm]	Sum Flux [lm]	Zonal Flux [%]	Sum Flux [%]
0	2643.47	0.00	0.00	0.00	0.00
5	2547.27	61.41	61.41	5.44	5.44
10	2189.53	163.69	225.10	14.51	19.95
15	1716.07	219.05	444.15	19.41	39.36
20	1201.18	221.66	665.81	19.64	59.00
25	718.86	178.74	844.55	15.84	74.84
30	311.06	108.46	953.02	9.61	84.45
35	56.58	31.74	984.76	2.81	87.26
40	37.46	13.24	998.00	1.17	88.44
45	32.87	12.61	1010.61	1.12	89.55
50	29.66	12.46	1023.07	1.10	90.66
55	27.51	12.24	1035.31	1.08	91.74
60	26.54	12.36	1047.68	1.10	92.84
65	25.75	12.62	1060.30	1.12	93.96
70	25.69	13.09	1073.39	1.16	95.12
75	25.64	13.50	1086.88	1.20	96.31
80	25.97	13.88	1100.77	1.23	97.54
85	25.61	13.97	1114.73	1.24	98.78
90	26.10	13.76	1128.49	1.22	100.00


C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

SPACE ISOLX DIAGRAM

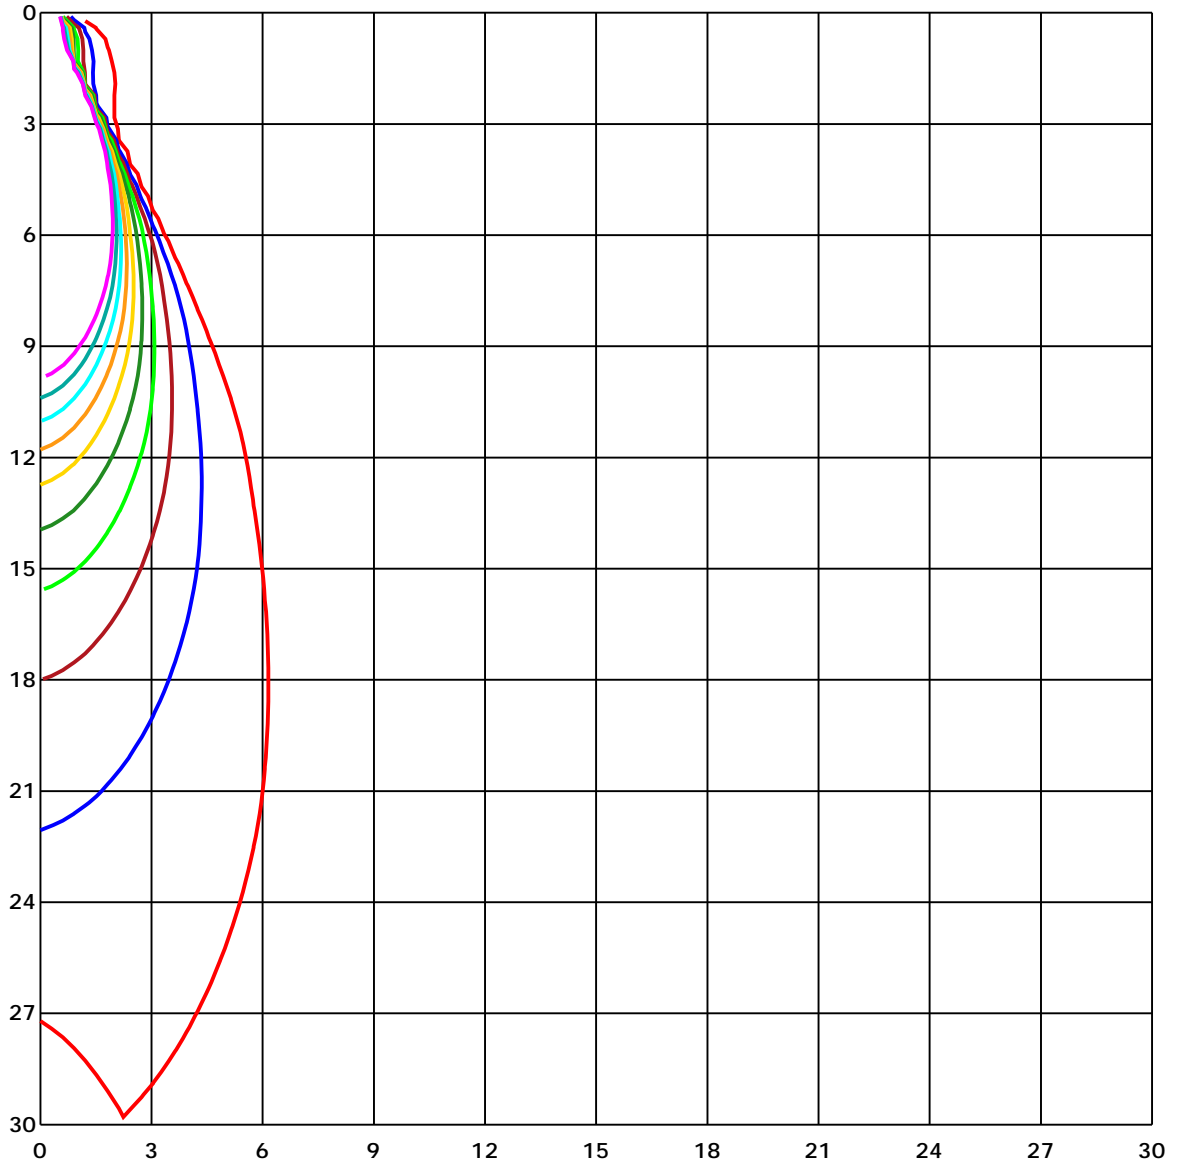

Unit of illumination: lx

- | | |
|----------|----------|
| — 27.121 | — 13.561 |
| — 24.409 | — 10.849 |
| — 21.697 | — 8.136 |
| — 18.985 | — 5.424 |
| — 16.273 | — 2.712 |

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

LUMINOUS DISTRIBUTION INTENSITY DATA

Gamma/C	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G0	2637.55	2655.17	2650.02	2631.13	2637.55	2655.17	2650.02	2631.13	2637.55	
G1	2604.49	2601.1	2605.74	2613.32	2660.02	2700.84	2682.64	2638.2	2604.49	
G2	2561.26	2539.08	2553.02	2582.53	2667.86	2731.52	2699.68	2630.07	2561.26	
G3	2508.44	2466.23	2491.04	2540.65	2658.63	2742.83	2698.0	2609.27	2508.44	
G4	2450.98	2388.38	2421.03	2488.16	2634.92	2733.35	2686.21	2575.16	2450.98	
G5	2376.19	2302.79	2342.56	2424.64	2596.62	2708.47	2652.76	2529.34	2376.19	
G6	2300.75	2212.24	2255.8	2350.58	2548.75	2670.75	2608.29	2480.75	2300.75	
G7	2217.86	2111.41	2163.54	2266.02	2486.37	2621.02	2554.99	2414.94	2217.86	
G8	2129.69	2012.36	2065.3	2177.66	2414.64	2563.89	2493.77	2345.88	2129.69	
G9	2037.79	1908.61	1968.8	2083.98	2339.02	2487.83	2424.02	2266.16	2037.79	
G10	1943.48	1806.2	1873.99	1986.61	2252.81	2414.32	2342.52	2187.77	1943.48	
G11	1845.35	1704.57	1776.22	1892.3	2162.92	2327.82	2259.12	2097.0	1845.35	
G12	1745.35	1604.72	1675.75	1791.61	2068.51	2236.07	2167.63	2003.21	1745.35	
G13	1647.04	1509.57	1581.33	1694.75	1970.01	2141.07	2066.17	1907.88	1647.04	
G14	1545.84	1411.33	1483.96	1603.07	1871.4	2042.97	1961.8	1808.21	1545.84	
G15	1444.02	1311.59	1385.35	1506.62	1770.63	1941.19	1856.55	1703.87	1444.02	
G16	1340.41	1214.18	1288.79	1407.75	1668.01	1837.07	1741.89	1599.57	1340.41	
G17	1230.31	1116.01	1191.23	1305.9	1564.04	1735.58	1620.88	1494.4	1230.31	
G18	1125.24	1021.96	1094.67	1204.4	1455.62	1630.69	1499.14	1388.45	1125.24	
G19	1024.04	930.76	999.63	1103.57	1353.1	1533.69	1377.76	1286.89	1024.04	
G20	926.63	842.18	909.67	1003.5	1243.15	1434.64	1259.31	1188.5	926.63	
G21	828.79	754.73	819.34	909.09	1140.42	1322.24	1139.1	1093.57	828.79	
G22	738.06	671.41	738.24	814.96	1036.48	1204.29	1028.2	996.13	738.06	
G23	652.04	589.94	656.67	722.45	937.69	1092.59	916.86	895.62	652.04	
G24	575.86	522.12	580.9	642.92	839.7	980.22	813.17	795.99	575.86	
G25	511.44	457.81	514.83	566.3	747.95	872.93	716.61	703.15	511.44	
G26	435.41	373.83	451.75	499.58	659.08	771.26	629.93	623.84	435.41	
G27	338.84	281.49	366.82	430.12	585.2	677.79	563.93	560.54	338.84	
G28	243.88	191.6	265.29	332.89	520.45	604.79	498.96	493.74	243.88	
G29	157.56	116.67	179.38	238.7	438.69	541.31	419.14	397.03	157.56	
G30	95.36	66.94	106.16	154.35	331.03	479.37	320.49	295.65	95.36	
G31	57.28	48.52	62.46	86.97	238.08	383.46	226.48	204.04	57.28	
G32	46.73	44.33	50.34	52.72	151.62	288.9	146.55	123.75	46.73	
G33	42.87	41.48	45.97	45.64	86.57	196.67	83.8	74.02	42.87	
G34	40.68	39.84	43.27	42.17	56.18	124.77	52.13	53.63	40.68	
G35	39.04	35.79	41.15	39.98	49.69	70.23	44.84	48.08	39.04	
G36	37.65	34.66	39.58	38.56	45.86	51.95	41.52	45.02	37.65	

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

LUMINOUS DISTRIBUTION INTENSITY DATA(Continue 1)

GammaC	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G37	36.34	35.86	38.23	37.07	43.41	46.88	39.55	42.72	36.34	
G38	35.28	34.95	37.07	35.86	39.58	43.89	38.16	41.11	35.28	
G39	34.33	34.04	38.27	35.06	39.66	41.99	36.99	39.33	34.33	
G40	33.67	33.53	37.43	34.26	38.38	40.2	36.08	38.2	33.67	
G41	33.02	32.43	34.29	33.34	37.14	37.72	35.42	37.07	33.02	
G42	32.18	32.1	33.56	32.69	36.23	37.98	34.62	34.48	32.18	
G43	31.3	31.45	33.02	32.25	35.2	37.1	33.89	34.91	31.3	
G44	30.79	30.68	32.54	31.67	34.33	36.08	32.69	34.22	30.79	
G45	31.96	30.13	31.78	33.23	33.45	35.35	32.18	33.16	31.96	
G46	29.4	29.26	33.34	30.5	32.98	34.69	32.14	32.8	29.4	
G47	28.75	28.64	30.46	29.88	32.29	34.07	30.02	31.81	28.75	
G48	30.17	30.21	31.48	29.26	31.37	33.38	31.12	31.16	30.17	
G49	29.66	27.76	29.29	28.57	32.29	28.71	30.64	30.35	29.66	
G50	27.25	27.54	29.0	28.09	30.02	31.81	30.28	29.77	27.25	
G51	28.78	27.18	28.67	29.77	29.29	31.19	29.59	29.0	28.78	
G52	28.13	26.96	28.46	27.36	28.75	30.02	24.84	28.64	28.13	
G53	26.08	28.6	28.35	26.89	30.17	29.88	28.67	28.09	26.08	
G54	25.76	26.34	28.31	26.6	27.87	28.86	28.35	27.98	25.76	
G55	27.54	26.16	25.17	26.27	27.54	28.49	23.97	27.54	27.54	
G56	25.32	26.05	27.91	26.12	29.0	28.02	27.58	27.03	25.32	
G57	25.28	25.9	27.69	25.97	26.78	27.43	27.29	26.89	25.28	
G58	25.06	27.84	27.65	25.9	26.7	27.14	27.14	28.64	25.06	
G59	24.99	25.57	27.4	25.76	26.49	26.89	26.7	28.49	24.99	
G60	25.03	25.65	27.22	25.79	26.23	26.92	26.74	26.38	25.03	
G61	25.06	25.54	26.78	27.29	26.19	26.41	26.3	26.23	25.06	
G62	24.92	25.46	23.75	25.39	26.01	28.09	26.3	26.16	24.92	
G63	25.25	26.92	26.49	25.46	25.79	26.05	26.01	26.12	25.25	
G64	25.21	25.57	26.41	25.46	25.61	26.08	25.83	25.83	25.21	
G65	25.46	26.23	26.27	26.45	25.68	25.87	25.65	25.83	25.46	
G66	25.5	25.54	26.05	26.52	25.57	25.83	25.68	27.76	25.5	
G67	25.46	25.72	27.07	25.54	25.68	25.76	25.65	25.72	25.46	
G68	25.46	25.83	25.79	25.54	25.61	25.76	25.46	25.79	25.46	
G69	25.46	26.01	25.83	25.65	25.54	25.76	25.54	25.76	25.46	
G70	25.46	26.01	27.4	25.21	27.65	25.68	25.39	25.5	25.46	
G71	25.28	25.94	25.57	25.28	25.46	25.72	25.46	25.9	25.28	
G72	25.03	26.19	25.65	25.72	27.43	27.62	27.32	25.76	25.03	
G73	25.1	26.19	27.69	24.55	25.39	25.61	25.39	25.79	25.1	

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks:

Report No.:

Test Time: 2022/1/3 15:33:36

LUMINOUS DISTRIBUTION INTENSITY DATA(Continue 2)

Gamma\C	C0	C45	C90	C135	C180	C225	C270	C315	C360	
G74	24.77	26.34	25.76	25.97	25.43	25.5	25.43	25.9	24.77	
G75	24.66	26.38	25.57	25.87	25.39	25.5	25.43	25.83	24.66	
G76	24.41	26.45	25.61	26.01	25.46	25.57	27.29	26.05	24.41	
G77	24.22	26.38	27.62	26.16	27.32	27.29	25.39	26.05	24.22	
G78	24.22	26.34	27.58	26.19	25.14	25.76	27.4	26.16	24.22	
G79	26.16	26.3	27.51	26.12	25.28	25.68	25.28	25.43	26.16	
G80	24.19	26.27	25.57	26.27	25.5	26.01	25.39	24.11	24.19	
G81	25.97	26.23	25.46	26.34	25.54	25.87	25.43	24.52	25.97	
G82	25.94	26.05	25.46	26.16	26.23	26.23	25.32	26.56	25.94	
G83	24.3	26.08	25.5	26.23	25.57	26.27	25.32	26.34	24.3	
G84	24.15	25.83	25.57	26.19	25.76	23.53	27.32	26.52	24.15	
G85	24.11	25.54	25.54	26.27	25.65	26.38	25.35	26.49	24.11	
G86	24.08	25.83	25.54	26.05	24.84	26.3	25.35	26.56	24.08	
G87	26.01	23.38	25.54	26.12	25.65	26.49	27.32	26.56	26.01	
G88	24.26	25.35	25.83	25.32	25.28	25.28	25.5	27.54	24.26	
G89	25.1	25.32	26.63	27.03	25.39	25.39	26.38	27.54	25.1	
G90	22.16	27.84	0.0	23.79	27.97	0.0	26.36	0.0	22.16	

C Range: 0 - 360 Deg
 C Interval: 45.0 Deg
 Test Speed: High
 Temperature:
 Operators:
 Test Date: 2022/1/3 15:33:36

G Range: 0 - 90 Deg
 G Interval: 1.0 Deg
 Test System: Huipu CPM-1800B Goniophotometer
 Humidity:
 Test Distance: 6.04 m
 Remarks: